



Residential REPORTS

PRESALE REPORT

3 Scott Street

Narrabundah

REPORT PREPARED

15 July 2026



35 Poynton Street Hughes



6288 0402



info@residentialreports.com.au

ADDRESS	3 Scott Street Narrabundah	
CLIENT	Francesca Sfyarakis	
OCCUPANCY STATUS	unoccupied - the dwelling was unfurnished at the time of the inspection	
INSPECTOR - Adam Macie	INSPECTION DATE - 14 July 2026	WEATHER CONDITIONS - Light rain
JOB REFERENCE - 47407	BLOCK - 46	SECTION - 82

INSPECTION DATA SUMMARY

YEAR OF DEVELOPMENT (APPROX. ISSUE OF FIRST CERTIFICATE OF OCCUPANCY)	2009
AREA DETAILS (APPROX. SQM)	- Residence - 260sqm off plan - Garage - 39.6sqm off plan - Block size - 626sqm
WALL CONSTRUCTION	brick veneer construction. For more information: visit residentialreports.com.au, click on 'resource library' and refer to the publication - Brick Veneer Walls
ROOF CONSTRUCTION	timber truss construction metal deck roof covering
FLOOR CONSTRUCTION	concrete slab construction
ENERGY RATING	4.5 stars
CONSTRUCTION	the dwelling is of adequate construction and structural workmanship for this type of residential development and its condition is commensurate with the era of construction, design, age and use
MAINTENANCE	there are maintenance items detailed in this report, please read the entire report
TIMBER PEST REPORT	- please review the entire report, including the <i>Timber Pest Overview and Recommendations</i> section, for complete details and context - no evidence of active subterranean termites (live species) was found at the time of our inspection - evidence of wood decay fungi (wood rot) was found exterior to the building at the time of inspection
COMPLIANCE REPORT	For details on structures in this block and section, see the compliance report

IMPORTANT: *This report is intended to be read in its entirety. You must carefully read the full document including Detailed Inspection Information, Warranty & Use and Scope & Limitations prior to making any critical decisions.* The above Data Summary is supplementary to the Report and should not be used as a standalone reference. It is imperative to review the complete Report and in the case of any discrepancies between the Report and the above comments, the information in the detailed Report is the final authority. The reader is requested to immediately contact us if any content is not fully understood and requires clarification or further explanation. We value the opportunity to work on this inspection project and wish you all the best as you evaluate this property.

Signed on behalf of:

Residential Reports Pty Limited ABN 38 609 880 122

Adam Macie


Adam Macie

Building & Timber Pest Assessor

INSPECTION SCOPE – INTRODUCTION FOR THE READER

The reader must refer to the comprehensive Warranty & Use and Scope & Limitations at the end of this report.

This report is written with reference to the Australian Standards outlined in our Scope & Limitations and is the result of a largely visual inspection only as required by the Standards. The inspection has been conducted to identify notable defects, insofar as an inspector can reasonably identify them and considering the building's age. Comments are provided primarily for items that could impact property value, normal wear and tear for an older building may not be detailed. If there are any discrepancies between the "Summary" and the Detailed Report, the Detailed Report should be relied upon. Where testing is undertaken and there are adverse findings, details will be noted. We do not inspect features such as electrical appliances, utilities, or swimming pool/s and equipment; qualified technicians should be consulted. This report does not quantify ongoing maintenance, upgrades, cosmetic works, or minor defects. If present, significant defects will be noted, and further investigation may be recommended. Where reference has been made to termites (live species, activity or prior activity) and maintenance or defects of significance, we strongly advise that prior to making any critical decisions, that the services of a suitably qualified tradesperson be engaged to quantify remedial action. Report comments may seem repetitive to emphasise that all inspected elements have been reviewed and a summary of inspection items is included at the end of the report for your reference.

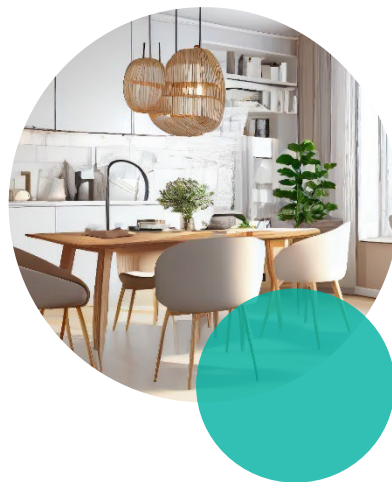

STANDARD INDICATORS EXPLAINED

Our Inspector uses the terms below to describe the condition of building elements. The inspection is visual and conducted under normal lighting. These terms consider factors like the building's age, construction quality and type. Keep in mind that what is considered "good" may vary between an older and a modern building. There are no estimates for repair costs reported, as these depend on your service provider and chosen action:

GOOD	The feature is generally in good condition and does not require major repairs. Minor imperfections in the finish or structure may be present. For elements like windows and doors, the observation refers to a visual inspection only, focusing on substantial defects affecting the property, not operational issues.
FAIR	The feature is functional but has deteriorated and would benefit from cosmetic or remedial repair work.
POOR	The feature in the inspector's opinion, requires remedial action. Repairs or replacement are considered necessary rather than discretionary.
NO SIGNIFICANT DEFECTS	This condition is applied when no significant structural or functional defects are observed. Minor issues may be present, and any remedial action is discretionary.
DEFECTS HAVE BEEN IDENTIFIED	This condition is applied where the inspector has identified defects that require remedial action or investigation considered necessary rather than discretionary.



IMPORTANT NOTE

Your inspector has conducted a comprehensive visual site assessment following Australian Standards for the Building Report and Timber Pest Report. Whilst the reports are considered separate, we've organised all the data for each area into a single table for your convenience. For example, when commenting on fences, you'll find information on both building maintenance and pest considerations in the one table. Where suspected water leakage, termite activity, active or latent, or building defects have been identified in this report, we strongly suggest further investigation. **The reader must refer to the comprehensive Warranty & Use and Scope & Limitations contained in this report as it contains important advice for intending purchasers and for the owner of this building.** A proactive approach to building maintenance and timber pest management is essential to the upkeep of the property.

INTERIOR

Entrance

ceilings and cornices	good
architraves and skirting boards	good
walls	good
doors and windows internal	good

Bedroom One

ceilings and cornices	good
architraves and skirting boards	good
walls	fair the corner wall lining is loose with movement present
doors and windows internal	fair - the entrance door is binding with the frame, adjustment is required - the windows require adjustment to ensure smooth operation

Bedroom Two

ceilings and cornices	good
architraves and skirting boards	fair there is evidence of moisture penetration to the window architrave. No elevated moisture readings were recorded at the time of inspection
walls	good
doors and windows internal	good

Bedroom Three

ceilings and cornices	good
architraves and skirting boards	good
walls	good
doors and windows internal	good

Bedroom Four

ceilings and cornices	good
architraves and skirting boards	good
walls	good
doors and windows internal	good

Ensuite

ceilings and cornices	good
architraves and skirting boards	good
walls	good
doors and windows internal	fair the windows require adjustment to ensure smooth operation
vanity/hand basin	good
shower screen	fair the shower screen door is not operating smoothly, adjustment or repair is required
toilet suite	good
ventilation	ceiling fan unit (with heat lamps)
water leakage	no water leakage detected in accessible areas
wall tiles	good
floor tiles	fair there are stains to the tiling adjacent to the vanity
fit-out	good
hardware, fixtures and fittings	good

Bathroom

ceilings and cornices	good
architraves and skirting boards	good
walls	good
doors and windows internal	fair the door hardware requires some repairs
vanity/hand basin	good
shower screen	good
bath	good
ventilation	ceiling fan unit (with heat lamps)
water leakage	no water leakage detected in accessible areas
wall tiles	fair - there are imperfections to the wall tiling from a previous installation - there is staining to the bath hob tiles
floor tiles	good
fit-out	good
hardware, fixtures and fittings	good

Toilet

ceilings and cornices	good
architraves and skirting boards	good
walls	good
doors and windows internal	good
toilet suite	good
vanity/hand basin	good
water leakage	no water leakage detected in accessible areas
ventilation	ventilation is provided by a ceiling mounted exhaust fan
floor tiles	good
hardware, fixtures and fittings	good

Laundry

ceilings and cornices	good
architraves and skirting boards	good
walls	good
doors and windows internal	good
laundry tub	good
water leakage	no water leakage detected in accessible areas
ventilation	there is no mechanical ventilation
wall tiles	good
floor tiles	fair there is staining to the floor tiles in some areas
hardware, fixtures and fittings	good
fit-out	fair there is a small chip to the benchtop

Kitchen and Family Area

ceilings and cornices	good
architraves and skirting boards	good
walls	fair there is some minor movement cracking to the wall lining - this is a cosmetic matter and repairs required are minimal
doors and windows internal	good
sink	good
splashback	good
ventilation	ventilation is provided by an externally ducted range hood
hardware, fixtures and fittings	fair there is a missing drawer face below the oven
kitchen fit-out	good there are water stains visible underneath the sink. We are unable to determine if there is any ongoing water leakages, however, the area was dry at the time of inspection
fit-out	fair there is a stain to the family room unit benchtop
floor coverings	fair there is evidence of moisture penetration to the floating flooring adjacent to the patio door, slight elevated moisture readings were recorded

Study

ceilings and cornices	good
architraves and skirting boards	good
walls	good
doors and windows internal	good

Living and Dining Area

ceilings and cornices	good
architraves and skirting boards	good
walls	good
doors and windows internal	good

Hallway

ceilings and cornices	good
architraves and skirting boards	good
walls	good
doors and windows internal	good

Roof Cavity

insulation	• the roof cavity is insulated with fibreglass batts
sarking	• insulated sarking has been installed in the roof cavity
roof construction	• timber truss construction • truss webs have been cut to trusses over the laundry area to allow for duct installation. This may affect the structural integrity of the trusses and repairs are recommended
termites - roof void	• no active termites and/or termite damage or workings were observed in the areas accessible at the time of inspection
wood decay - roof void	• no evidence of wood decay (rot) fungi damage was sighted in areas accessible at the time of inspection
borers - roof void	• no evidence of borer damage was sighted in areas accessible at the time of the inspection

Interior/Main Dwelling

termites - interior	• no active termites and/or termite damage or workings were observed in the areas accessible at the time of inspection
wood decay - interior	• no evidence of wood decay (rot) fungi damage was sighted in areas accessible at the time of inspection
borers - interior	• no evidence of borer damage was sighted in areas accessible at the time of the inspection

Inspection Items	
roof exterior	defects have been identified - metal deck roof covering - the condition of the metal roof covering is commensurate with the age of construction, typically over time some fixings will ease and the sheeting will deflect and there can be oxidation of the metal surface At this inspection we found no evidence of roof leakages - removal of leaf litter and debris from roof is recommended
gutters and downpipes	no significant defects
eaves, fascia and barge ends	no significant defects
wall construction exterior	defects have been identified - brick veneer construction - there are cracks in the rendered walls, while the cracks were not considered to be structurally significant at the time of our inspection, they should be monitored over time to ensure that there is no ongoing movement
doors and windows external	no significant defects
floor construction	no significant defects - concrete slab construction - there is no evidence that the floor has any significant defects, floor coverings prohibit a visual inspection so it is possible that some minor defects may be concealed
driveway	defects have been identified there is some movement cracking in the driveway
paths and paving	no significant defects
retaining walls	no significant defects
grounds	no significant defects
fences and gates	defects have been identified - vegetation and screening in some areas of the fence line limited our inspection. We were unable to determine the condition of the fencing in those areas - timber decay is evident in timbers that are in contact with the ground in some areas - damage in the area/s noted appears to be moderate - repairs are required to some areas of the fencing

Patio	
patio construction	good concrete slab
drainage	good drainage appears to be directed away from the dwelling, however, this was not tested at the time of inspection

Patio - Side

patio construction	good • tiled floor construction
drainage	good • drainage appears to be directed away from the dwelling, however, this was not tested at the time of inspection

Garage

description	• the double garage is under the roof line
wall construction exterior	good • brick construction
floor construction	good • concrete slab construction
doors	good • one panel lift door has been fitted
ceilings and cornices	fair • there is cracking along the cornice line in some areas • there is some minor movement cracking to the ceiling lining - this is a cosmetic matter and repairs required are minimal • there are water stains on the ceiling, electronic moisture meter testing and our visual inspection did not identify any current water leakage at the time of inspection. It is not possible to determine when the leakage occurred, and under what circumstances, or to eliminate the possibility of further leakage in the future, we recommend monitoring changes and consulting a suitably qualified expert if required
walls	good
doors and windows internal	good
termites - garage	• no active termites and/or termite damage or workings were observed in the areas accessible at the time of inspection
wood decay - garage	• no evidence of wood decay (rot) fungi damage was sighted in areas accessible at the time of inspection
borers - garage	• no evidence of borer damage was sighted in areas accessible at the time of the inspection

Deck and Pergola - Bed Four

decking timbers	good
deck support posts	good • deck support posts are supported by metal stirrups
pergola roof	fair • roof covering is showing signs of deterioration
hand railing/balustrade	good
structural integrity	good
termites - deck pergola	• no active termites and/or termite damage or workings were observed in the areas accessible at the time of inspection
wood decay - deck pergola	• no evidence of wood decay (rot) fungi damage was sighted in areas accessible at the time of inspection
borers - deck pergola	• no evidence of borer damage was sighted in areas accessible at the time of the inspection

Deck and Pergola - Laundry

decking timbers	good
deck support posts	good
hand railing/balustrade	good
pergola roof	good
structural integrity	good
termites - deck pergola	no active termites and/or termite damage or workings were observed in the areas accessible at the time of inspection
wood decay - deck pergola	no evidence of wood decay (rot) fungi damage was sighted in areas accessible at the time of inspection
borers - deck pergola	no evidence of borer damage was sighted in areas accessible at the time of the inspection

Deck

decking timbers	good
hand railing/balustrade	good
structural integrity	good
termites - deck	no active termites and/or termite damage or workings were observed in the areas accessible at the time of inspection
wood decay - deck	no evidence of wood decay (rot) fungi damage was sighted in areas accessible at the time of inspection
borers - deck	no evidence of borer damage was sighted in areas accessible at the time of the inspection

Pergola

pergola roof	good adjustable metal fins
structural integrity	good steel construction

TIMBER PEST - OVERVIEW & RECOMMENDATIONS

Overall risk - pest	considering all of the relevant factors, it is our opinion that the overall degree of risk of timber pest infestation to the property is HIGH - we strongly recommend that regular inspections are undertaken
Evidence of timber pests	- no evidence of active subterranean termites (live species) was found at the time of our inspection - evidence of wood decay fungi (wood rot) was found exterior to the building at the time of inspection
Evidence of a termite nest	no, please read the report in full
Evidence of a pest treatment	- we found a preventative treatment notice posted in the meter box - a chemical treatment was applied at the time of construction, this treatment has exceeded its life expectancy
Pest treatment required?	considering there is no evidence of a pest treatment, we recommend that a regular pest management program in accordance with Australian Standard 3660.1 to prevent subterranean termites from infesting the property be implemented. A proactive approach to Timber Pest Management will offer the highest protection for the building. A management proposal can be obtained by contacting our office on 6288 0402, or please contact your regular inspector.
We recommend pest inspections are conducted every:	6 to 12 months
Drainage and ventilation	concrete slab construction - not applicable
Mould	mould was not observed at time of inspection Mould on walls and ceilings etc; is an indicator of high moisture or very poor ventilation. If reported you should commission further investigation by a builder or an Industry Hygienist as its presence may indicate a water leak, wood decay or termites behind the wall or ceiling sheeting.
Weep holes	Were the weep holes clear allowing the free flow of air? yes Weep holes are small openings that allow water to drain from within an assembly. Weeps are located at the bottom of the building to allow for drainage. It is important that soil, lawn, concrete paths or pavers do not cover the weep holes. Sometimes they have been covered during the rendering of the brick work. They should be clean and free flowing. Covering the weep holes in part or in whole may allow undetected termite entry.
Slab edge exposure	Is the slab edge exposed? no, not applicable as construction is an infill slab Where external concrete slab edges are not exposed there is a high risk of concealed termite entry. In some buildings built since July 1995 the edge of the slab forms part of the termite shield system. In these buildings an inspection zone of at least 75mm should be maintained to permit detection of termite entry. The concrete edge should not be concealed by render, tiles, cladding, flashings, adjoining structures, paving, soil, turf or landscaping etc. Where this is the case, you should arrange to have the slab edge exposed for inspection. Concealed termite entry may already be taking place but could not be detected at the time of the inspection. This may result in concealed timber damage.

Termite shields (ant caps) cont.	In our opinion the termite shields appear to be: not applicable, concrete slab construction Termite Shields should be in good order so termite workings are exposed and visible. This helps stop termites gaining undetected entry. Joins in the shielding should have been soldered or sealed with an approved sealant as per AS 3660 during the installation. Whenever it is observed that the joins in the shielding have not been soldered then the shielding must be reported as inadequate. It may be possible for a builder to repair the shielding. If not, a chemical treated zone may need to be installed to deter termites from gaining concealed access to the building. Missing, damaged or poor shields increase the risk of termite infestation. Other physical shield systems are not visible to inspection and no comment is made on such systems.
Hot water, air conditioning and water tanks	Units that release water alongside or near to building walls need to be connected to a drain. If this is not possible then their water outlet needs to be piped several meters away from the building, as the resulting wet area is highly conducive to termites. Is there a need for work to be carried out? not applicable to this property
General recommendations	- As this property is located in an area where subterranean timber pests are commonly found we strongly recommend that you have regular inspections carried out no later than every 6 - 12 months (or as specifically recommended above) to ensure that there is no termite activity present in your buildings and structures. - Any untreated timbers in direct contact with the soil are very conducive to attack from subterranean termites. These should be removed and replaced with a material not conducive to attack such as brick, stone, concrete or treated timber. - Garden beds, mulch and foliage against the structure can create conditions that are highly conducive to timber pest attack. Clearing is recommended. - Large trees (particularly eucalypt variety) are regular nesting sites for the most common termite species found in our region. Trees on the property have been visually inspected up to a height of 2 metres, where possible and practicable for signs of termite activity. It is however, very difficult and generally impossible to locate a termite nest visually as they are underground and evidence in trees is usually well concealed. Drilling and testing of large trees is recommended to determine if they are harbouring a termite nest.

It should be noted that if the risk factor specified in this report is considered to be high it is encouraging awareness that increased vigilance is warranted. Any recommendations regarding reducing conditions that are conducive to timber pests or frequency of inspections must be observed. If termite activity, active or latent, has been identified in this report, we strongly suggest an invasive inspection is carried out. To safeguard against potential timber pest attack, we recommend that a full inspection be undertaken every 6-12 months at a minimum or as specifically recommended above. We strongly encourage the property owner to consider implementing a Timber Pest Preventative Management Plan, which includes periodic Termite Inspections. A proactive approach will help ensure the ongoing protection of the property. Please call our office on 6288 0402 for advice and information or to arrange a customised schedule for this building or contact your regular inspector.

COMPLIANCE REPORT

Plan No. (if applicable)	Description	Date of COU Approvals (Certificate of Occupancy)	Comments
082812/A	demolition of residence	04/05/2009	
091375/A+/B	residence & garage	04/05/2009	
101668/A	pergola	11/10/2010	
	garden shed		• approval is not required
	bed four pergola		• approval is required - the structure exceeds allowable dimensions for exemption • over 3m high
	laundry deck and pergola		• approval is required - the structure exceeds allowable dimensions for exemption • over 3m high
	driveway screens		• approval is required - the structure exceeds 0.4m in height and is located between the building line and a boundary line facing crown land
	garden screens		• approval is required - the structure exceeds allowable dimensions for exemption • over 2m high
	masonry garden feature		• approval is required - the structure exceeds allowable dimensions for exemption • masonry over 1.8m high

For any incomplete approvals please email acbuildingconveyance@act.gov.au for further information on how to complete.

COMPLIANCE REPORT NOTATION

IMPORTANT NOTE - We obtained a Building File from Access Canberra to complete this Compliance Report. This report relates to Building and Development approvals only. The building file may contain floor plans, elevations, Certificates of Occupancy & Use, index, survey reports, and drainage plans. Our report is based on examining these documents and conducting a visual inspection, focusing on compliance matters from the provided file. Please be aware that if plan details are unclear or compromised, we are not liable for any omissions or errors. Refer to more details about Compliance in our Scope & Limitations. For information regarding current dimensions and approvals you can visit: planning.act.gov.au/topics/design_build/da_assessment/exempt_work

EASEMENTS - An easement is a section of land registered on your property which gives another party the right to access it for a specific purpose. An example is a section of the property that contains municipal services such as electricity, or drainage infrastructure. If a structure requires approval and is located on an easement the appropriate utility provider is consulted during the certification process and it is they who determine if an application for approval will be supported.

TCCS, PLUMBING & ELECTRICAL APPROVAL - If this report notes structures or alterations that require Transport Canberra & City Services (TCCS), Plumbing or Electrical Approval or cites plumbing and electrical additions and/or alterations, please note that approval may have been granted, however, documentation is not provided in the building file. The Environment & Planning Directorate or the owner may have further information.

DEVELOPMENT APPROVAL - If this report identifies structures that require Development Approval, information relating to the status of Development Approvals will be shown on the Lease Conveyancing Enquiry provided by the solicitor. This will be included in the Conveyancing Contract for Sale. The status of a pending Development Approval is not contained within the building file we receive.

SWIMMING POOLS & SPAS - The ACT Government has introduced reforms to home swimming pool safety, with a focus on swimming pool safety barriers. The reforms commence on 1 May 2024, with a four-year transition period. The scheme imposes requirements for information about the safety standard of a regulated swimming pool to be disclosed on the sale of a property. Owners must provide prescribed information including: exemption certificate, compliance certificate, swimming pool disclosure statement, certificate of occupancy for the pool and safety barriers that is not older than 5 years and 'Pool Owners Guidance Material' which outlines the obligations on owners of premises on which a regulated swimming pool is located. If this information is not provided in this report, you must request a copy. For more information on the reforms visit the ACT Government's Planning website.

EXTENSIONS - Where an extension or addition has been made to a property, it can create a potential gap or discontinuity in the termite barrier system. This gap occurs between the original structure and the new addition. Termite barriers are critical in aiding the prevention of undetected subterranean termites from entering the dwelling, and any interruption in the barrier can compromise its effectiveness. We are unable to report on the existence, condition or continuity of the termite barrier system between the existing dwelling and additions or alterations.

Restricted access caused by stored goods, furnishings, window treatments, floor coverings, security devices, vegetation, duct work, confined spaces, insulation and other impediments will limit the scope of this inspection. Whilst every effort has been made to conduct a comprehensive roof cavity and subfloor inspection there are limitations relative to safe access requirements which include low clearances, the availability of safe walk-ways and work-safe temperatures, which when applicable, will limit the inspection. The roof exterior is inspected when accessible from a 3.6 metre ladder, or from ground level where there are height restrictions. Only structures, fences and/or trees within 30m of the building but within the property boundaries were inspected. No inspection was made, and no report is submitted with respect to inaccessible areas. These include, but may not be limited to, cavity walls, concealed frame timbers, eaves, flat roofs, fully enclosed patios, subfloors, soil concealed by concrete floors, wall linings etc. Where a property is furnished at the time of the inspection the furnishings and stored goods may be concealing evidence of Timber Pest Activity. This evidence may only be revealed when the property is vacated. A further inspection of the vacant property is strongly recommended in this case. Please note where a complete inspection of any area was not possible, timber pest activity and/or damage may exist in these areas. Prior to making any critical decisions, further inspections are strongly recommended to areas where reasonable access is unavailable, obstructed or restricted or a high risk of possible timber pests and /or damage exists.

3 Scott Street Narrabundah	
Area	Restrictions
INTERIOR	access during inspection of the interior of the property was restricted by: - window treatments and floor coverings
SUBFLOOR	there is no subfloor, the dwelling is constructed on a concrete slab
ROOF CAVITY	our inspection of the roof cavity was significantly restricted by: - low clearances - insulation covering the ceiling framing - inspection around the eaves was restricted due to low pitch and clearances - sarking and duct work - safe access limitations did not allow for all areas of the roof to be inspected
ROOF EXTERIOR	roof exterior: - safety harness anchors and edge restraints were not available. Work Health and Safety regulations required a top of ladder inspection
GROUND & EXTERNAL STRUCTURES	access to the inspection of grounds/external structures was restricted by: - vegetation restricted visual inspection to some areas

WARRANTY & USE OF OUR REPORTS

This report is **intended to be read in its entirety**. The report is written solely for the use and benefit of:

The Client named in this report

The Purchaser of the property

No liability or responsibility in contract or tort or statute is accepted to any Other Party who may rely on the report wholly or in part. Any Other Party acting or relying on this report, wholly or in part, does so at their own risk. Additionally, no liability or responsibility will be accepted if the invoice for this report is not paid on or before settlement of the sale contract or within one hundred and eighty (180) days from the date of inspection.

No liability shall be accepted on account of failure of the report to notify any termite activity and/ or damage present at or prior to the date of the report in any areas of the subject property physically inaccessible, or to which access for inspection is denied by or to the Inspector including but not limited to any areas so specified by the Report. Furthermore, we do not assume liability for any omissions, errors, or inaccuracies in documents provided by external agencies, the client, or their representative. The report is only an opinion of Residential Reports and is valid for one hundred and eighty (180) days from the date of inspection as per the Civil Law (Sale of Residential Property) Act. No liability will be accepted or claims considered after the expiration of this period of liability.



Before the property exchange, you will have the opportunity to attend a pre-settlement inspection to conduct your due diligence. Carefully consider the building's age and its impact on elements like windows, doors, and cupboards. Our inspectors do not assess ongoing maintenance, and as such you or your representative should personally appraise relevant building elements. If it is claimed that there is an omission relating to this report, Residential Reports must be notified in writing before any action is taken. No liability shall be accepted where any costs (including for remedial action or professional advice) are incurred by the claimant prior to Residential Reports receiving written notification along with evidence of the defect or omission, being given a reasonable opportunity to re-inspect the property, obtain professional advice and propose a resolution or arrange for rectification work to be undertaken. Unless costs are specified and agreed to in writing, no liability will be accepted. No liability shall be accepted for any costs incurred in excess of the reasonable costs required to rectify the defect or omission claimed. ***This report supersedes any other report, verbal or written, given to you by this company in respect of this property. If you have questions or do not understand any part of this document and require clarification, please contact us prior to acting on this report. Copyright remains with Residential Reports, the report content, style and presentation is not to be copied or reproduced without written authority of the Company.***

SCOPE & LIMITATIONS OF OUR INSPECTION

This report has been prepared as a result of a largely **VISUAL INSPECTION ONLY** with limited operational testing conducted as required by Australian Standard AS 4349.0-2007 Inspection of Buildings (General requirements), AS 4349.1-2007 Inspection of Buildings (Pre-purchase inspections - Residential Buildings) and AS 4349.3 - 2010 Inspection of Buildings Part 3: Timber Pest Inspections. It is limited to the condition of those areas of the property that were fully accessible (see Safety and Reasonable Access) and visible to the inspector at the time of inspection. In the case of a Strata type property, our inspector only undertakes an examination of the interior of the unit. You must read the entire report and Scope & Limitations sections before reaching any conclusions regarding our opinion of the property's condition. Any person relying on this report acknowledges the following clauses, which define the Scope and Limitations of the inspection and form an integral part of the report.

LIMITATION OF LIABILITY

This report is valid on the date of inspection. Responsibility is not accepted for any matter that is not evident, or, for any deterioration of the property that occurs after the date of the inspection. The inspection is a visual assessment only.

The operation/working condition of limited features may have been commented on during the course of our inspection. Operational testing is limited, where testing occurs and a defect is identified, this defect may be noted in the Report if it is a major defect and may be investigated further to provide more detail. However, this does not impose on the inspector any further obligation to test each same item, nor does it impose an obligation to make note if in the inspector's reasonable view, the defect is not a major defect. There is no guarantee

that items referenced will operate as intended at a later date. Prior to purchase, the purchaser must conduct their own due diligence most particularly where defects have been documented in this report so that they are able to quantify the extent and cost of required remedial action. The Purchaser acknowledges that they should not solely rely on this Report as to the exact condition of the property and that they should obtain independent advice from a qualified technician relative to required remedial actions.

Concealed areas are not reported on. Concealed defects may include, but are not limited to:

- Breakage, blockage or interference with concealed pipes, concealed window and door mechanisms
- Defective service installations
- Any part of the structure which is underground or concealed e.g. footings, wall and ceiling framing, concealed floor structures
- Areas concealed by furnishings, fixtures and fittings or stored goods, low clearances or where safe access is not possible.

Responsibility is not accepted for defects which are latent or otherwise not reasonably detected in a visual inspection without interference with, removal or breaking apart of any of the structure including fixtures, fittings, furniture, insulation or stored items within and around the building. The inspector notes that some defects may be concealed, obstructed and/or inaccessible at the time of the inspection. The reader should be aware that various features of the property such as large and heavy furniture, as well as electrical goods including washing machines and fridges may obstruct the view of the inspector and/or make possible defects inaccessible such that their visibility to the inspector is limited and they may not be identified. The Purchaser acknowledges that Residential Reports will not accept any liability for concealed, obstructed and/or inaccessible defects that the inspector does not identify.



EXCLUSION OF ITEMS FROM INSPECTION

AS 4349.1 – 2007 excludes reporting of the following items: Footings below ground, concealed damp-proof course, electrical installations, operation of smoke detectors, light switches and fittings, TV, sound and communications and security systems, concealed plumbing, adequacy of roof drainage as installed, gas fittings and fixtures, air-conditioning, automatic garage door mechanisms, swimming pools and associated filtration and similar equipment, the operation of fireplaces and solid fuel heaters, including chimneys and flues, alarm systems, intercom systems, soft floor coverings, electrical appliances including dishwashers, incinerators, ovens, ducted vacuum systems, paint coatings, except external protective coatings, health hazards (e.g., allergies, soil toxicity, lead content, radon, presence of asbestos or urea formaldehyde), timber and metal framing sizes and adequacy, concealed tie-downs and bracing, timber pest activity, other mechanical or electrical equipment (such as gates, inclinators, soil conditions, control joints, sustainable development provisions, concealed framing-timbers or any areas concealed by wall linings/sidings, landscaping, rubbish, floor covers, furniture and accessories, stored items, insulation, environmental matters (e.g., BASIX, water tanks, BCA Environmental Provisions), energy efficiency, lighting efficiency.

WHAT THE INSPECTOR EXAMINES TO PREPARE A PROPERTY REPORT...

...AND IMPORTANT NOTES ABOUT THESE AREAS

The following outlines aspects of the property that can be examined through visual inspection, derived from the Australian Standard AS4349.1–2007. Comments are generally provided only if significant issues are found. The inspector didn't move or remove any coverings or furnishings, which could hide defects. Damage to concealed structures or pest activity may not be visible due to foliage or other obstructions. This report is a guide for potential buyers and should complement your own inspection and due diligence. Some aspects are subjective, so consider factors like presentation, past maintenance, and construction age when forming opinions.

DOORS & DOOR FRAMES - Defective hardware – significant, rotting/corroded frames, loose/badly fitting doors, damage.

EXTERNAL ROOF COVERING, FASCIAS, GUTTERS & DOWNPIPES - Tiles/slates, sheet roofing, flashing, skylights, vents, downpipes, valleys, guttering, eaves, fascia boards, barge ends. Roof waterproof integrity and roof drainage is not tested during our inspection therefore it is not possible to determine the effectiveness of the roof cover and drainage system under all conditions. It is important to note that a visual inspection of the roof covering may not identify roof leakages. Roof design can have a significant impact on roof drainage. Low pitched construction can, in adverse weather conditions lead to flooding of the roof cover. Effective roof drainage is absolutely critical for a flat framed or low pitch roof. Flooding of the roof cover can result in water ingress within the building envelope. Roof drainage and the stormwater systems are not tested at the inspection. Inadequate, blocked or non-existent stormwater drains are often accountable for problems relating to roof drainage. Repainting of timber can mask the existence of timber rot. We cannot guarantee that all timbers are sound. A visual inspection may not, in some circumstances, detect roofing timbers affected by rot.

EXTERNAL WALLS & NON-STRUCTURAL RETAINING WALLS - Bricks, mortar, render, cracking/movement, dampness, visible flashing, weep holes, joint sealants, perpends, decay. Settlement cracks, if present, need to be monitored over a period of time to determine if an ongoing structural problem exists. If any reference has been made in this report to cracking, settlement and or movement, it should be noted that we are not experts in this area and further advice, if considered necessary, should be obtained from a Structural Engineer.

FENCES & GATES - Palings/panels, rails, posts, sagging, timber decay (rot).

FLOORS - **TIMBER**: Springy or squeaky boards/sheeting, timber decay (rot), out of level – significant, undulations - significant, dampness/water damage; **CONCRETE**: cracking, out of level – significant; **HARD FLOORING**: cracking, loose or drummy units, dampness/water damage

INTERNAL ROOF SPACE - Framing, insulation, sarking, party walls (if applicable). Sarking is a foil insulation/vapour barrier. Used in conjunction with bulk insulation, sarking provides an ideal insulation system for the control of heat and condensation. Sarking can only be installed during construction.

KITCHEN - Fit out, sealants, ventilation, taps, leakage, sink, drummy/cracked/missing tiles, grout defects. This report does not cover any matters relating to the operation of electrical or gas appliances. Any comments made in this regard are from a general observation only.

PAINTWORK - The condition of painted surfaces is often a subjective matter. Areas that appear to be acceptable when furnished may not always be considered so when devoid of obstructions. Paint work is normally not considered in Property Inspections. To prevent wood decay of timber surfaces and deterioration of metal components, the condition of these surfaces should be monitored, and repainting carried out regularly. Corrosion of any metal roof sheeting should be repaired, treated and painted to avoid water leakages. Painted surfaces can mask areas where timber has deteriorated. Our visual inspection may not detect instances where this has occurred. The opinions provided here are of a general nature only, given that there can be significant differences in the condition of painted surfaces in each area of the property. The reader of this report is urged to conduct their own detailed inspection before reaching a conclusion regarding the acceptability of painted surfaces

PATHS, PAVING & DRIVEWAY - Cracking, movement, uplifting, sinking, alignment, roof penetration.

SPECIAL PURPOSE REPORTS - Improvements such as swimming pools and spas are subject to a Special Purpose Report and are not included in our inspection and reports. We recommend that a qualified technician be engaged to report on these items and to advise on current regulations relating to safety fencing and equipment.

STAIRCASES - Stringers, handrails, balustrades, newel posts, treads (goings), risers

SUB FLOOR - Dampness, debris, drainage, ventilation, cracked or leaking pipes; **TIMBER CONSTRUCTION**: bearers & joists, framing, piers/stumps; **SUSPENDED CONCRETE FLOOR CONSTRUCTION**: concrete condition, cracking. If moisture is noted, it is recommended that the sub-floor area be monitored to ensure that surface and sub-surface moisture ingress is not an ongoing issue. If the area remains damp, consideration should be given to upgrading subterranean and surface drainage systems to ensure that moisture is directed away from the building foundations and the sub-floor area is kept dry. A qualified drainage expert should be consulted with regard to drainage issues.

Foundation problems are caused by reactive soil types and trees and gardens being planted too close to the building. Generally, clay soils which are common in the ACT, are reactive soils. Large trees use vast amounts of water and can quickly draw moisture out of the ground during dry periods, this results in destabilised moisture content of the soils around the building and ultimately may cause a foundation problem. Over watering gardens close to the building may have the opposite effect, especially with clay soil. Over watering increases the moisture content of the soil which can result in “heaving” of the foundations adjacent to the garden. When watering close to the building you should avoid ‘pooling’ of water in a particular area, as this also affects the moisture content of the soil which in turn can cause damage to footings and foundations. Too much or too little water near the perimeter of the building may cause serious problems with foundations and footings and damage can cause major structural problems, resulting in costly repairs.

HINTS FOR AVOIDING PROBLEMS AND COSTLY REPAIRS:

- Water gardens evenly close to the building and do not over water
- Ensure the ground is graded away from the walls of the building and that the property has adequate drainage
- Promptly repair broken downpipes, leaking taps, sewerage pipes and other water services
- Hot water system overflows should be directed away from the area immediately adjacent to the foundations and the services maintained to ensure excessive leakage does not occur
- Garden beds should not be located against the house

TIMBER PESTS - Our visual inspection is undertaken to identify the following timber pests: Subterranean termites, Borers, Timber decay (rot) fungi. Where applicable and where there is reasonable access, the following areas are examined: interior and exterior of structures, roof cavity, subfloor, garage or carport, garden and storage sheds/outbuildings, retaining walls and garden borders, pergolas and decks, structures, fences and trees within 30m of the building within the boundaries of the property. Water leaks: especially in the subfloor or against external walls e.g. leaking taps, roofs or down pipes, increases the likelihood of termite attack. Leaking showers or leaks from other 'wet areas' also increase the likelihood of concealed timber pest attack. Where evidence of termite activity was found in the grounds then the risk to buildings is very high. A treatment to eradicate the termites and to protect the building(s) should be immediately carried out. Where the evidence of termite workings (including dormant mud leads) was found in the grounds or the building(s) then the risk of a further attack is very high. If live termites or any evidence of termite workings or damage was reported within the building(s) or in the grounds and fences then it must be assumed that there may be concealed termite activity and/or timber damage. This concealed activity or damage may only be found when alterations are carried out such as when wall linings, cladding or insulation are removed or if you arrange for an invasive inspection. In situations where visual evidence of termite activity or damage is reported, but no live termites were observed during the inspection, it's important to recognise that termites might still be active in the immediate vicinity, potentially causing further damage. Determining whether the infestation is active or inactive requires multiple inspections over time, as various factors, such as prior disturbances, climatic conditions, or the termites finding an alternative food source, can influence their presence during a single inspection. To safeguard against potential termite-related issues, we recommend continued, regular inspections. **An invasive inspection is also an option for a more comprehensive assessment. We strongly encourage the property owner to consider implementing a Timber Pest Preventative Management Plan, which includes periodic Termite Inspections. This proactive approach will help ensure the ongoing protection of the property against potential termite threats. Please call our office on 6288 0402 for information and to arrange a customised schedule for this building or contact your regular inspector.**

WALL CONSTRUCTION - Distortion (significant), nail popping, defective lining, dampness/water damage, cracking, defective or damaged plaster/render. Settlement cracks, if present, need to be monitored over a period of time to determine if an ongoing structural problem exists. If any reference has been made in this report to cracking, settlement and/or movement, it should be noted that we are not experts in this area and further advice should be obtained from a Structural Engineer.

WATERPROOFING - A VISUAL INSPECTION OF THE AREA CANNOT PROVIDE CONCLUSIVE EVIDENCE THAT THE AREA IS WATERPROOF. Compliance with Australian Standard AS 370-2004 Waterproofing of Wet Areas is critical to meeting waterproofing requirements. Should conclusive evidence be required regarding the integrity of waterproofing of wet areas, in particular shower areas, we recommend that a qualified technician be engaged to complete a comprehensive test to include:

- Capping the shower rose and leaving the water reticulation system under pressure and then checking for evidence of water leakage around tap spindles etc. (the sound of escaping air when the shower rose cap is removed indicates a watertight system). The technician may be engaged to complete a comprehensive pressure test of the entire water reticulation system.
- Plugging the floor drain of the shower cubicle and filling the base with water to the maximum level. Allowing the water to remain in the base for an extended period and checking that the level has not dropped. If the water has diminished it is most likely that the waterproofing system has failed.

WET AREAS - Fixtures and fittings, ventilation, cistern/pan, taps, basins, tubs, leakage, sealants, drummy/cracked/missing tiles, grout defects, vanity, shower leakage, broken/cracked glass. If a wet area was not in service prior to and or at the time of inspection and no elevated moisture readings were recorded, or there was no visible evidence of current water leakage, then it is possible that an existing water leak will remain undetected.

WINDOWS - Putty/glazing sealant, broken glass, rotting frames (timber), corrosion (metal), sills, fittings/hardware, damage. In most cases access to windows is restricted by window treatments, furniture or security locks. Older style timber windows can sometimes bind with the frame. This is viewed as a general maintenance issue. Sash windows sometimes require maintenance to the window balance mechanism or sash cords. A visual inspection cannot provide a guarantee that windows will operate smoothly. Sometimes window runners, sashes and balance mechanisms will require maintenance or replacement.



SAFETY & REASONABLE ACCESS

Australian Standard 4349.1 – 2007 3.2.2 The extent of accessible areas shall be determined by the inspector at the time of inspection, based on the conditions encountered at the time of inspection. The inspector shall also determine whether sufficient space is available to allow safe access. The inspection shall include only accessible areas and areas that are within the inspector's line of sight and close enough to enable reasonable appraisal. The Australian Standard 4349.3 defines reasonable access as "areas where safe, unobstructed access is provided and the minimum clearances are available; or, where these clearances are not available, areas within the consultant's unobstructed line of sight and within arm's length. NOTE: Reasonable access does not include removing screws and bolts to access covers." Reasonable access is determined in accordance with the provisions of the following WHS requirements;

Area	Access Manhole MM	Crawl Space MM	Height
Subfloor	500 x 400	VERTICAL CLEARANCE - Timber Floor: 400* Concrete Floor: 500	Height
Roof Interior	400 x 500	600 x 600	Accessible from a 3.6 m ladder
Roof Exterior			Accessible from a 3.6 m ladder

** To underside of bearer, joist or other obstruction to access.*

ROOF COVER INSPECTION

Work Health and Safety requirements determine that an inspector accessing a roof cover must be protected by harnessed safety lines and or edge protection. These safety measures are not practical during a presale inspection, therefore, this report is restricted to a "top-of-ladder" inspection. This report is not a guarantee that defects and/or damage do not exist in any part of the property not specifically seen and described by the inspector. This report is not a warranty against problems that may develop in the future.

CEILING CAVITY INSPECTION

Work Health and Safety requirements determine that an inspector entering a ceiling cavity or similar space must have direct access to properly constructed walkways (sometimes referred to as catwalks) to eliminate the possibility of falling through the ceiling lining to the floor below, a fall that could result in serious injury. Generally, walkways are limited in a ceiling cavity so invariably sections of the roof structure will be inspected from a distance with the inherent limitations associated with limited access and often an impaired line-of-sight. Safety requirements prevent the inspector from traversing a ceiling cavity where safety elements are not available. This report is not a guarantee that defects and/or damage do not exist in inaccessible areas.

WORK HEALTH & SAFETY ACT 2011

A non-residential building and the common property of some group residential buildings will fall within the definition of a workplace for the purposes of the Work Health and Safety Act 2011. The owners of workplaces must ensure that:

- Premises are safe and without risk
- Plant and substances are used without risk
- Workers are trained in WHS, are aware of their obligations and do, in fact, act in a safe manner

A pre-purchase building inspection may identify some safety issues in the common area but it is not an audit conducted for that specific purpose. It is essential that every Owners' Corporation or Company consult an appropriately qualified specialist to ensure it meets its legislative obligations.

SAFE WORKING TEMPERATURES FOR THE INSPECTOR

When the temperature of a workspace (for example a ceiling cavity) exceeds the level considered to be safe according to WHS guidelines, the inspector will complete a risk assessment and the inspection will be limited accordingly. In the event that the inspector determines that the temperature exceeds safe working limits, generally, the inspection will be limited to the area immediately adjacent to the access for inspection.

PROPERTY REPORT

This report does not and cannot make comment upon: defects which may have been concealed; the assessment or detection of defects (including rising damp or leaks) which may be subject to the prevailing weather conditions; whether or not services have been used for some time prior to the inspection and whether this will affect the detection of leaks or other defects; the presence or absence of timber pests; gas fittings; environmental concerns; the proximity of the property to flight paths, railways, or busy traffic; noise levels; health and safety issues; heritage concerns; security concerns, fire protection; site drainage (apart from surface water drainage). The operation of swimming pools and spas; detection and identification of unapproved building work; detection and identification of illegal or inadequate plumbing or electrical work; durability of exposed finishes; neighbourhood problems; document analysis; any matters solely regulated by statute; any area or item that could not be inspected by the inspector. Unless otherwise specified, no examination has been made of any documentation of any type. We have not referred to statutory authority records nor have we examined any survey or water and sewerage service diagram, or any other document prepared by any statutory authority or other party. Stock images in the report are for presentation purposes only and are not images of the subject property.

PURPOSE OF THE REPORT - The purpose of this report is to identify major defects in the building, decks, pergolas, garages and other similar significant improvements insofar as a property inspector can reasonably identify those defects. Structures, not limited to but including, garden sheds, play equipment, garden trellis, swimming pools and spas are not inspected or included in this report. A Special Purpose Report may be commissioned for these types of improvements. This report contains numerous observations but is not intended to list every defect. Defects are common to all structures and generally are commensurate with the age of the construction and use. Ongoing maintenance, upgrading or replacement requirements, cosmetic works and minor defects or faults are subjective and have not been included.

CONCEALED SURFACES - The inspection did not include breaking apart, dismantling, removing or moving objects, including but not limited to foliage, mouldings, roof insulation or sisalation, floor or wall coverings, sidings, ceilings, floors, furnishings, equipment, appliances, or personal possessions. The inspector cannot see inside walls, between floors, inside skillion roofing, behind stored goods or any other areas that are concealed or obstructed. The inspector did not dig, gouge, force or perform any other invasive procedures. Visible timbers have not been destructively probed or hit. In an occupied property, furnishings or household items may be concealing defects. Some defects may only be visible once furniture and other items have been removed from a property or when alterations are carried out. Built-in cupboards are usually filled with personal items and clothing. Some exterior surfaces may be obscured due to overgrown vegetation. Therefore, we cannot comment on the condition of the surfaces obscured or concealed by these or other items.

WATER PENETRATION & ROOF DRAINAGE - Some water penetration problems and/or dampness within a building do not become apparent and may not be detected unless there has been recent heavy rain or prolonged periods of rain. If moisture has been identified by the inspector using electronic testing equipment, then it will be noted in the report. Roof drainage is not tested. Therefore, no guarantee is given or implied that the roof will remain weatherproof in all weather conditions. If there is reference in the report to water stains within the interior of the property this may be evidence that the roof and or drainage system has previously leaked. We recommend that you contact a suitably qualified roofing expert to discuss the probability of ongoing water leakages in the building. Particularly with respect to older properties and where the roof has a low pitch, engaging the services of qualified roof plumber to provide an expert opinion should be considered. The very best roof drainage systems can fail in extreme weather conditions sometimes impacted by conditions not related to the property under review. (Blocked or impaired stormwater drains for example).

FIRE PROTECTION EQUIPMENT & ORDINANCE REQUIREMENTS - These are not covered by this report and these matters should be checked with the statutory authority. Any fire protection equipment has not been tested, e.g. smoke detectors etc.

HAZARDOUS MATERIALS & CONTAMINATION - Our inspection and report does not cover any hazardous materials or prior use of the land and building or any chemicals applied to land and buildings, which may have caused contamination.

RETAINING WALLS & STRUCTURAL COLUMNS - We are not engineers. Comment in respect of large and/or structural retaining walls and columns are beyond the scope of this report. It is not possible to determine from a visual inspection whether a retaining wall or column has been built in accordance with sound engineering principles and, even if it has, whether it is or will remain sound. An engineer should be consulted in any case where there are large, or structural, retaining walls, columns or similar building elements.

INTERNAL WALLS & CEILINGS - Movement cracking in ceiling and wall linings are common to most structures particularly older developments. Mostly they are cosmetic and generally have no structural implications. Repairation is usually undertaken during routine maintenance. Undulations in ceiling linings are often associated with older structures and are a result of the deterioration of the adhesive used to fix plasterboard to the ceiling battens. Typically, this is a cosmetic defect, however, in some circumstances the plasterboard may require refixing to the battens.

CRACKING/SETTLEMENT/MOVEMENT & STRUCTURAL INTEGRITY - Where reference has been made in this report to cracking, settlement, movement or an opinion has been provided on structural integrity, it is important to note that we are not experts in this area and our advice is limited accordingly. If considered necessary, further advice should be obtained from a Structural Engineer before critical decisions are made. Any cracking reported should be monitored for further movement. If further movement is noted, a Structural Engineer should be consulted at the earliest opportunity. Cracking of masonry walls is very common in the ACT, particularly where there are volatile clay soils. There may be some superficial or hairline cracks that we consider have no structural implications which have not been identified.

ELECTRICAL, GAS & OTHER SERVICE INSTALLATIONS - We are not licensed electricians, gas fitters or mechanical engineers. This report does not cover any matters relating to electrical and gas installations or any apparatus operated by electronic, mechanical or hydraulic means. This report does not cover any matters relating to the operation of electrical or gas appliances. Any comments made in this regard are from a general observation only. You should satisfy yourself as to the operation and condition of any appliances or other installations. Any comments made in this regard are from general observation only. There has been no electrical, data, security or fire detection system testing or investigation.

PLUMBING & DRAINAGE - We are not licensed plumbers and a specialist inspection of the water service, plumbing and drainage system including roof drainage is excluded from this report. We recommend an inspection by a licensed plumber and drainer to identify any plumbing faults or drainage problems.

TIMBER PESTS - If this report does not include one, we strongly recommend that an independent inspection and report be obtained from an accredited Pest Inspector to determine whether the property is free from infestation (whether active or dormant).

BOUNDARIES - Unless otherwise stated, the inspector has not gained access to any neighbouring properties and is therefore unable to comment upon the external state of any boundary fences and walls. The common areas of unit developments are not inspected. Any comments made in relation to common areas are strictly observational.

RURAL PROPERTY INSPECTION - This inspection and report relates to the residential structure; rural improvements on the property are not inspected or reported on, any comments contained in this report relative to rural improvements are strictly observational.

AREAS AND DIMENSIONS - Whilst every care has been taken to accurately quantify dimensions referenced in this report, we accept no responsibility for inaccuracies as supplying this information exceeds the requirements of a standard building inspection as per Australian Standard 4349.1-2007. In many instances scale plans are not available and therefore the reader should not rely on this report when making critical decisions relating to dimensions.

ELEVATED STRUCTURES - Where reference has been made in this report to an elevated structure such as a deck balcony or veranda, it is important to note that we are not Structural Engineers and accordingly our advice is limited. Any opinion relating to structural integrity is relative to weight loadings typical of a normal household event. Prior to loading the structure beyond normal, which may occur at a larger gathering, we recommend that professional advice be obtained to determine that the structure will safely cope with the weight loading. Additionally, the structure should be regularly inspected to ensure that structural integrity is maintained.

SPECIAL PURPOSE REPORTS - This Property Report does not contain any assessment or opinion in relation to any item which is the subject of a Special Purpose Property Report, or any matter where the inspection or assessment of which is solely regulated by Statute. Special Purpose Property Reports include comment on the following: common property areas, environmental concerns such as sunlight, privacy, streetscape and views, proximity of property to flight paths, railways and busy traffic or other neighbourhood issues; noise levels; WHS issues including, but not limited to the presence of asbestos, lead or other hazardous materials; heritage concerns; security or fire protection systems; climate control or water heating systems; analysis of site drainage apart from surface water drainage; swimming pools and spas; detection and identification of illegal and unauthorised plumbing work; durability of exposed finishes.

COMPLIANCE REPORT

The information within this report relies on the plans, survey reports, certificates of occupancy and other relevant documents supplied by the Environment & Planning Directorate (EPD), the appropriate local council or Directorate, the client or their agent. Our company or its employees are not responsible for any omissions or errors where incomplete, inaccurate or illegible information is supplied. It is the responsibility of the property owner to resolve any file discrepancies with the relevant authority. Documentation of any plumbing or electrical alterations is not included in the building file. If required, this documentation can be obtained by the title holder from the relevant utilities provider. If the subject property features a second driveway or verge crossing, Transport Canberra & City Services approval may be required. This information is not supplied in the building conveyancing file. If this report confirms that certification is 'pending' for an unapproved structure, it is important that you are aware that this process can take weeks and involve more than one agency including but not limited to the Environment & Planning Directorate, Icon & Transport Canberra & City Services. Whilst it is rare, in some instances throughout the approvals process an application may be rejected. The Compliance Report relies on documentation provided in the Building File. Residential Reports Inspectors are not Building Surveyors. Certifications included in the file are not cross referenced with the Building Code of Australia (BCA) applicable at the time of construction to confirm that the improvements are compliant with the BCA. This is the responsibility of the Building Surveyor prior to issuing a Certificate of Occupancy. No attempt is made in this inspection and reporting process to confirm that the existing improvements on the subject property are in strict accordance with approved plans. There may be variations in design, features and dimensions that conflict with each other. Additionally, there is no guarantee given that improvements are in accordance with the current Building Code of Australia. In most circumstances, there is no requirement to upgrade specifications to the current Building Code.

SWIMMING POOLS & SPAS - The ACT Government has introduced reforms to home swimming pool safety, with a focus on swimming pool safety barriers. The reforms commence on 1 May 2024, with a four-year transition period. The scheme imposes requirements for information about the safety standard of a regulated swimming pool to be disclosed on the sale of a property. Owners must provide prescribed information including: exemption certificate, compliance certificate, swimming pool disclosure statement, certificate of occupancy for the pool and safety barriers that is not older than 5 years and 'Pool Owners Guidance Material' which outlines the obligations on owners of premises on which a regulated swimming pool is located. If this information is not provided in this report, you must request a copy. For more information on the reforms visit the ACT Government's Planning website.

TIMBER PEST REPORT

This report is the result of a VISUAL INSPECTION ONLY. Inspection of the property and this report has been completed with reference to AUSTRALIAN STANDARD AS 4349.3 - 2010 Inspection of buildings Part 3: Timber Pest Inspections. In all instances throughout this report the inspector is referring to accessible areas only. Areas that were not accessible at the time of inspection or were concealed from view are not covered by this report. The inspector does not imply that inaccessible or partly inaccessible areas of the property were not, or have not been, infested by Timber Pests. This Report is not a guarantee that an infestation or future infestation and/or damage does not exist in any inaccessible or partly inaccessible areas of the property. This inspection DID NOT include breaking, removing or moving objects, floor and wall coverings, roof insulation, foliage, furniture, appliances stored goods and personal possessions - these all limit the scope of inspection. The inspector does not have access to the inside of walls, between flooring, inside eaves and skillion roofing. This Report is confined to reporting infestation and/or damage caused by white ants (subterranean and damp wood termites), borers of seasoned timber and timber pests (wood decay fungi), present on the date of the Inspection. The Inspection did not cover any other pests and this Report does not comment on them. Dry wood termites and European House Borer (*Hyloterpes bujulus* Linnaeus) are excluded from the inspection due to the extreme difficulty in locating the small colonies. Some species of termite and house borers, if discovered, will be reported (by law) to Government Authorities.

TERMITE RECOMMENDATIONS - Where evidence of termite activity or workings was found in any structure then the risk to buildings is very high and the risk of further attack is also high. A treatment to eradicate the termites and to protect the building(s) should be carried out. If live termites or any evidence of termite workings or damage was reported within the building(s) or in the ground and fences then it must be assumed that there may be concealed termite activity and/or timber damage. This concealed activity or damage may only be found when alterations are carried out such as when wall linings, cladding or insulation are removed or if you arrange for an invasive inspection. We claim no expertise in engineering or building. We strongly recommend that you have a qualified person such as a Builder, Engineer, Architect or other qualified expert in the building trade determine the full extent of the damage, if any. This may require an invasive inspection. We take no responsibility for the repair of any damage whether disclosed by this report or not.



Where visual evidence of termite workings and/or damage is reported but no live termites were present at the time of inspection, you must realise that it is possible that termites are still active in the immediate vicinity and the termites may continue to cause further damage. It is not possible, without benefit of further investigation and a number of inspections over a period of time, to ascertain whether any infestation is active or inactive. Active termites may simply have not been present at the time of inspection due to a prior disturbance, climatic conditions, or they may have been utilising an alternative feeding source. Continued, regular, inspections are essential. Unless written evidence of a termite protection program in accord with "Australian Standard 3660" with ongoing inspections is provided, you must arrange for a treatment in accord with the standard to be carried out immediately to reduce the risk of further attack.

Where the evidence of live termite or termite damage or termite workings (mudding) was found in the building (s) then the risk of a further attack is very high. Where evidence of live termites or termite damage or termite workings was found in the grounds but not in the buildings then the risk to buildings is very high.

If evidence of drill holes in concrete or brickwork or other signs of a possible previous treatment is reported then the treatment was most likely carried out because of an active termite attack. Extensive structural damage may exist in concealed areas. You should have an invasive inspection carried out and have a builder determine the full extent of any damage and the estimated cost of repairs as the damage may only be found when wall linings etc are removed. Normally if a termite treatment has been carried out then a durable notice should be located in the meter box indicating the type of termite shield system, treated zone or combination has been installed.

BORER RECOMMENDATIONS - Borer activity is usually determined by the presence of exit holes and/or frass. Since a delay exists between the time of initial infestation and the appearance of these signs, it is possible that some borer activity may exist that is not discernible at the time of inspection. If borers are identified replacement of all susceptible timbers is always preferred since, in the event of selling the property in the future it is probable that an inspector will report the borers as active. A chemical treatment to control and/or protect against Furniture beetle and/or Queensland pine beetle can be considered as a less effective, lower cost option. Before considering this option You should consult with a builder to determine if the timbers are structurally sound. Following the initial treatment, a further inspection is essential in twelve months' time to determine if further treatment is needed. Treatments over a number of consecutive years may be required. The *Lyctus brunneus* (powder post beetle) is not considered a significant pest of timber. Damage is confined to the sapwood so treatment or timber replacement is not usually required. However, you should have a building expert investigate if any timber replacement is required. *Anobium punctatum* (furniture beetle) and *Calymnaderus incisus* (Queensland pine beetle) must always be considered active, unless proof of treatment is provided, because, unless the timber is ground up, one cannot determine conclusively if activity has ceased. Total timber replacement of all susceptible timbers is recommended. A secondary choice is treatment. However, the evidence and damage will remain, and the treatment may need to be carried out each year for up to three years.

HIGH MOISTURE READINGS, DRAINAGE & VENTILATION - High moisture readings can be caused by any one of the following: poor ventilation, ineffective drainage, leaking pipes, leaking roofs, defective flashing or by concealed termite activity. The areas of high moisture should be investigated by way of an invasive inspection. High moisture levels also increase the likelihood of termite attack and may also be conducive to borer activity and wood decay. If high moisture was reported then you must have a building expert investigate the moisture and its cause and determine the full extent of damage and the estimated cost of repairs.

If drainage is considered inadequate, a plumber or other building expert should be consulted, and remedial measures should be taken. Ventilation of the sub-floor region is important in minimising the opportunity for subterranean termites to establish themselves. Consideration should be given to installing high air flow vents and/or improve the cross flow of air within the subfloor to produce ventilation equivalent to 8400 sq mm net ventilation area per lineal metre on external and internal walls.

INFILL AND CONCRETE SLABS - Any building or part of a building that is constructed on a concrete slab is always more susceptible to termite attack because of possible concealed termite entry. A very high proportion of termite attacks are over the edge of both infill and other concrete slab types. If the edge of the slab is concealed by concrete paths, patios, pavers, garden beds, lawns, foliage, etc then it is possible for termites to conceal their entry into the property. Termites can then cause extensive damage to concealed framing timbers. Even the most experienced inspector may be unable to detect their presence due to concealment by wall linings. Only when the termites attack timbers in the roof void, which may in turn be concealed by insulation, can their presence be detected. Infill slab type construction has an even higher risk of concealed termite ingress as the slab edge is concealed due to the construction design and is not exposed. The type of slab may only be determined by assessment of the construction plans by a qualified person such as a Builder, Certifier or Architect. Construction Plans may be obtainable by your conveyancer. Termite activity and or damage may be present in concealed timbers of the building. We strongly recommend frequent regular inspections

in accordance with AS 3660.2. Where the slab edge is not fully exposed, or the slab is an infill slab or the slab type cannot be determined then we strongly recommend inspections every 3 to 6 months in accordance with AS 3660.2. Infill slab: A slab on the ground cast between walls. Other slabs should be in accordance with AS 2870 - 1996 and AS 3660.1-2000.

TIMBER (FUNGAL) DECAY - We claim no expertise in building and if any evidence of fungal decay or damage is reported you should consult a building expert to determine the full extent of damage and the estimated cost of repairs or timber replacement.

DETERMINING EXTENT OF DAMAGE - This Report is NOT a structural damage report. You agree that we are not responsible or liable for the repair of any damage, whether disclosed by our report or not. Our inspectors are not necessarily specialised builders and any inexperienced opinion provided with respect to timber damage cannot be relied upon. The Report will not state the full extent of any timber pest damage; rather, we may provide comment on the damage for your information. If evidence of Timber Pest activity and/or damage is reported in the structure(s) or the grounds of the property, then you must assume that there may be further concealed structural damage within the building(s). This concealed damage may only be found when invasive procedures are applied to reveal previously concealed timbers. In the case of Timber Pest activity and/or damage WE STRONGLY RECOMMEND an invasive Timber Pest Inspection is undertaken and a qualified person such as a Builder, Structural Engineer, or Architect be engaged to carry out a structural inspection to determine the full extent of the damage and repairs that may be required.

MOULD - Mould (also referred to as Mildew and non-wood decay fungi) is not considered a Timber Pest. This report does not extensively cover the inspection of Mould. If evidence of mould was observed during the inspection, it may be noted for your information. If you are concerned as to the possible health risk resulting from the presence of mould, then you should seek advice from your local State or Commonwealth Government Health Department expert.

IMPORTANT INFORMATION

This Report reflects the condition of the property existing at the time of the inspection date and may not reflect the current state. Timber Pests, particularly termites, may have gained entry to the property since the inspection date. Termites can, in a relatively short period, cause significant damage to both structural and non-structural timbers within and around the buildings of the property. Termites are difficult to detect and much of the damage caused may not be readily visible, if damage exists, it may be costly to repair. If the Report indicated the presence of termites, termite damage, previous activity or treatments, or recommends a treatment, you should obtain copies of the treatment proposal, any certificates of treatments carried out, details of all repairs including copies of quotations, invoices and any other reports. It is strongly recommended that you arrange for an inspection in accordance with AS 4349.3 to verify that the treatment has been successful and carried out in accordance with AS 3660.2 and arrange for a further building inspection in accordance with AS 4349.1. The person carrying out the inspection and this company will have no liability to you for any damage or loss you may suffer as a result of your entering the contract to purchase the property or in connection with completing the purchase of the property as a result of your failure to heed the advice given in this report and may use such failure in defence of any claim that you may later make against any of them.

Where a property is furnished at the time of inspection, you will appreciate that the furnishings, floor coverings and stored goods may be concealing any evidence of Timber Pest Activity which may only be revealed when the items are moved. Where fences are obscured by foliage, overgrowth or structures, evidence of timber pest activity or damage may be concealed. Poor subfloor drainage increases the likelihood of termite attack. If the risk factor stated in this report is high, this is the opinion of the inspector and should encourage awareness that increased vigilance is warranted and that recommendations for the reduction of unfavourable conditions that increase the chances of termite activity must be strictly observed. It is strongly recommended that a comprehensive timber pest inspection by a qualified timber pest inspector is undertaken every 6-12 months (or more frequently if specified in the report). Regular inspections DO NOT prevent timber pest attack. Regular inspections increase the chance of the early detection of timber pest activity thereby limiting the structural damage that may occur. The overall degree of risk of Timber Pest Infestation cited in this report is a subjective assessment by the inspector at the time of the inspection, taking into account many factors which include, but are not limited to, location and proximity to bushland and trees and/or other timber structures, evidence of timber pest damage or activity close to the inspected structure or within the inspected structure, conducive conditions that raise the potential of timber pest attack, such as timbers in contact with soil, inaccessible areas, slab on ground construction, or other factors that, in the inspector's opinion, raise the risk of future timber pest attack.

A more thorough INVASIVE INSPECTION is available. Where any current visible evidence of Timber Pest activity is found it is strongly recommended that a more invasive inspection is performed. Trees and stumps on the property with a diameter in excess of 100mm have been visually inspected for evidence of termite activity to a height of 2m where access was possible and practical. It is very difficult, and generally impossible to locate termite nests since they are underground and evidence in trees is usually well concealed. We therefore strongly recommend that you arrange to have trees test drilled for evidence of termite nests.

RESOURCE LIBRARY

Where reference is made to the Residential Reports Resource library, [you may access this content by clicking here.](#)

QUICK FACTS

- Sellers of residential properties are required to provide an Energy Efficiency Rating (EER) to potential buyers. (This is known as mandatory energy efficiency disclosure.)
- The EER forms part of the Sale Contract and must be published in all advertising material.
- The EER rating system uses computer simulations to assess the potential thermal comfort of your home.
- The more stars, the less likely the occupants need cooling or heating to stay comfortable.
- The ACT Government has two systems in place for Energy Ratings:

One is for established homes
(1st Generation Software)

One is for new homes
(2nd Generation Software)

Residential Reports (and all other companies preparing reports for the sale of a property on an existing Canberra home that has been previously occupied) are required to use 1st Generation Software.

- The consumption of energy in the home for heating, cooling, hot water or lighting and other appliances IS NOT considered in the application of 1st generation software when calculating the EER rating.
- Many aspects of solar passive designs are also not able to be accounted for in 1st Generation Software.

WHAT IS RATED?

The rating is dependent on:

- Layout of the home
- Construction of its roof, walls, windows and floor
- Wall, floor and ceiling insulations
- Orientation of windows and shading of the sun's path and local breezes
- Influence of the local climate

WHY IS THERE A DISCREPANCY BETWEEN MY OLD EER AND MY NEW EER?

- Increasingly, in a number of circumstances particularly where new homes have been rated using 2nd generation software and are now being offered for sale where the rating must be conducted using 1st generation software, there can be a significant variation between the two ratings:

1st generation software rates to 6 stars

2nd generation software may rate up to 10 stars

- ACT Legislation currently PROHIBITS Inspectors from assuming insulation values which may have been the case previously. Documented proof or visual sighting is now required to verify the existence and rating of insulation.


Your Energy Rating is calculated using software approved by the ACT Government.

Certificate of Currency

Policy Number	BP20200022		
Item 1 The Insured:	Residential Reports Pty Ltd		
Item 2 Address:	35 Poynton Street HUGHES ACT 2805		
Item 3 Professional Services covered by this policy:	Pre Purchase Building Inspections (AS4349.1) Special Purpose Building Inspections Energy Rating Reports Urban Pest Management Termite Management including inspections - existing buildings and structures (AS3660.2) Timber Pest Inspections (AS4349.3)		
Item 4 Description of the Policy:	Professional Indemnity & Broadform Liability (CGU PIB 03-17)		
Item 5 Period of Insurance:	From	20/07/2025	To 4.00 pm on 20/07/2026
Item 6 Particulars of Risk:	<u>Civil Liability Professional Indemnity</u>		
	6.1 The Policy Limit is	\$5,000,000	which includes all policy sections
	6.2 The Policy Excess is	\$20,000	
	6.3 The Retroactive Date is	20/07/2020	
	<u>Public Liability</u>		
	6.4 Sum Insured	\$20,000,000	
	6.5 Excess	\$2,500	

Date and Place of Issue 21/07/2025 Melbourne, Victoria

Signed for and on behalf of Insurance Australia Limited ABN 11 000 016 722



Najibi Bisso, Manager

This Certificate of Currency indicates policy cover effective as at the date of issue only

FirstRate Report



YOUR HOUSE ENERGY RATING IS: ★★☆☆☆ **4.5 STARS**
in Climate: 24 **SCORE: 3 POINTS**

Name: Francesca Sfyrakis

Ref No: 47407

House Title: Block 46 Section 82

Date: 14-07-2026

Address: 3 Scott Street

Narrabundah

2604

Reference: C:\REPORTS\...\SCOTT STREET NARRABUNDAH 3

IMPROVING YOUR RATING

The table below shows the current rating of your house and its potential for improvement.

Star Rating	POOR			AVERAGE				GOOD				V. GOOD
	0 Star	★		★★		★★★		★★★★		★★★★★		★★★★★★
Point Score	-71	-70	-46	-45	-26	-25	-11	-10	4	5	16	17
Current	3											
Potential	37											

Incorporating these design options will add the additional points required to achieve the potential rating shown in the table Each point represents about a 1% change in energy efficiency. This list is only a guide to the range of options that could be used.

Design options		Additional points	
Change glass to Double Glazing	100 %		12
Change curtain to Heavy Drapes & Pelmets			17
Add northerly blinds	100 %		5

FirstRate Mode
Climate: 24

RATING SUMMARY for: Block 46 Section 82, 3 Scott Street, Narrabundah

Assessor's Name: Kelly Hill

				Points		
Feature				Winter	Summer	Total
CEILING				7	0	7
Surface Area:	0	Insulation:	7			
WALL				6	-1	5
Surface Area:	0	Insulation:	6	Mass:	0	
FLOOR				11	0	11
Surface Area:	0	Insulation:	-3	Mass:	14	
AIR LEAKAGE (Percentage of score shown for each element)				6	0	6
Fire Place	0 %	Vented Skylights	0 %			
Fixed Vents	0 %	Windows	38 %			
Exhaust Fans	13 %	Doors	35 %			
Down Lights	0 %	Gaps (around frames)	15 %			
DESIGN FEATURES				0	1	1
Cross Ventilation	1					
ROOF GLAZING				0	0	0
Winter Gain	0	Winter Loss	0			
WINDOWS				-4	-21	-25
Window Direction	Area		Point Scores			
	m2	%NCFA	Winter* Loss	Winter Gain	Summer Gain	Total
NE	21	9%	-18	22	-3	1
SE	10	4%	-8	4	-2	-5
SW	14	6%	-13	6	-3	-10
NW	28	12%	-24	26	-12	-11
Total	73	32%	-62	58	-21	-25

* Air movement over glazing can significantly increase winter heat losses. SEAV recommends heating/cooling duct outlets be positioned to avoid air movement across glass or use deflectors to direct air away from glass.

The contribution of heavyweight materials to the window score is 6 points

				Winter	Summer	Total
RATING	★★★★☆	SCORE		26	-20	3*

* includes -2 points from Area Adjustment

Detailed House Data

House Details

ClientName	Francesca Sfyrakis
HouseTitle	Block 46 Section 82
StreetAddress	3 Scott Street
Suburb	Narrabundah
Postcode	2604
AssessorName	Kelly Hill
FileCreated	14-07-2026
Comments	Class A Building Assessor Lic No. 2022178

Climate Details

State	
Town	Canberra
Postcode	2600
Zone	24

Floor Details

<u>ID</u>	<u>Construction</u>	<u>Sub Floor</u>	<u>Upper</u>	<u>Shared</u>	<u>Foil</u>	<u>Carpet</u>	<u>Ins RValue</u>	<u>Area</u>
1	Concrete Slab on ground	No Subfloor	No	No	No	Carp	R0.0	128.7m ²
2	Concrete Slab on ground	No Subfloor	No	No	No	Tiles	R0.0	12.3m ²
3	Concrete Slab on ground	No Subfloor	No	No	No	Float Timb	R0.0	106.9m ²

Wall Details

<u>ID</u>	<u>Construction</u>	<u>Shared</u>	<u>Ins RValue</u>	<u>Length</u>	<u>Height</u>
1	Brick Veneer	No	R2.0	68.2m	2.7m
2	Weatherboard	No	R2.5	11.2m	2.7m

Ceiling Details

<u>ID</u>	<u>Construction</u>	<u>Shared</u>	<u>Foil</u>	<u>Ins RValue</u>	<u>Area</u>
1	Attic - Low Ventilation	No	Yes	R5.0	247.9m ²

Window Details

<u>ID</u>	<u>Dir</u>	<u>Height</u>	<u>Width</u>	<u>Utility</u>	<u>Glass</u>	<u>Frame</u>	<u>Curtain</u>	<u>Blind</u>	<u>Fixed & Adj Eave</u>	<u>Fixed Eave</u>	<u>Head to Eave</u>
1	SW	0.3m	1.2m	No	SGT	TIMB	NC	No	1.1m	1.1m	0.1m
2	SW	2.4m	2.7m	No	SG	ALIMPR	OW	No	0.1m	0.1m	0.4m
3	SW	2.4m	0.6m	No	SG	ALIMPR	OW	No	0.2m	0.2m	0.0m
4	NW	2.4m	1.0m	No	SG	ALIMPR	OW	No	0.0m	0.0m	0.0m
5	NW	2.4m	0.9m	No	SG	ALIMPR	OW	No	0.0m	0.0m	0.0m
6	NW	2.4m	0.9m	No	SG	ALIMPR	HB	No	0.0m	0.0m	0.0m
7	NW	2.4m	1.1m	No	SG	ALIMPR	HB	No	0.0m	0.0m	0.0m
8	NE	2.4m	0.5m	No	SG	ALIMPR	HB	No	5.3m	0.0m	0.0m
9	NE	2.4m	1.7m	No	SG	ALIMPR	OW	No	5.3m	0.0m	0.0m
10	NW	0.9m	1.5m	No	SG	ALIMPR	HB	No	3.3m	0.0m	0.0m
11	SW	2.4m	1.7m	No	SG	ALIMPR	NC	No	5.3m	0.0m	0.0m
12	SW	2.4m	0.5m	No	SG	ALIMPR	HB	No	5.3m	0.0m	0.0m
13	NW	2.4m	1.1m	No	SG	ALIMPR	OW	No	0.0m	0.0m	0.0m
14	NW	2.4m	0.9m	No	SG	ALIMPR	HB	No	0.0m	0.0m	0.0m
15	NW	2.4m	0.9m	No	SG	ALIMPR	HB	No	0.0m	0.0m	0.0m
16	NW	2.4m	0.9m	No	SG	ALIMPR	HB	No	0.0m	0.0m	0.0m
17	NW	2.4m	0.9m	No	SG	ALIMPR	HB	No	0.0m	0.0m	0.0m
18	NW	2.4m	1.1m	No	SG	ALIMPR	HB	No	0.0m	0.0m	0.0m
19	NE	2.4m	0.5m	No	SG	ALIMPR	HB	No	3.3m	0.0m	0.0m
20	NE	2.4m	1.7m	No	SG	ALIMPR	NC	No	3.3m	0.0m	0.0m
21	NW	2.1m	1.8m	No	SG	ALIMPR	HB	No	3.2m	0.0m	0.0m
22	NE	2.3m	1.8m	No	SG	ALIMPR	HB	No	0.0m	0.0m	0.0m
23	NE	2.1m	1.8m	No	SG	ALIMPR	HB	No	0.0m	0.0m	0.0m
24	SE	2.1m	2.8m	No	SG	ALIMPR	VE	No	0.0m	0.0m	0.0m

25	SE	1.4m	0.6m	Yes	SG	ALIMPR	HB	No	0.0m	0.0m	0.0m
26	SE	2.1m	0.9m	Yes	SG	ALIMPR	HB	No	1.7m	0.0m	0.0m
27	NE	2.1m	1.2m	No	SG	ALIMPR	CW	No	2.2m	0.0m	0.0m
28	SE	0.6m	2.0m	No	SG	ALIMPR	HB	No	0.0m	0.0m	0.0m
29	SE	0.6m	0.8m	No	SGT	ALIMPR	NC	No	0.0m	0.0m	0.0m

Window Shading Details

<u>ID</u>	<u>Dir</u>	<u>Height</u>	<u>Width</u>	<u>Obst Height</u>	<u>Obst Dist</u>	<u>Obst Width</u>	<u>Obst Offset</u>	<u>LShape Left Fin</u>	<u>LShape Left Off</u>	<u>LShape Right Fin</u>	<u>LShape Right Off</u>
4	NW	2.4m	1.0m	2.5m	5.4m	9.0m	-1.0m	0.0m	0.0m	0.4m	2.2m
5	NW	2.4m	0.9m	2.5m	5.4m	9.0m	-3.2m	0.0m	0.0m	0.4m	0.4m
6	NW	2.4m	0.9m	2.5m	5.4m	9.0m	-7.4m	0.4m	0.4m	0.0m	0.0m
7	NW	2.4m	1.1m	2.5m	5.4m	9.0m	-9.1m	0.4m	2.2m	0.0m	0.0m
8	NE	2.4m	0.5m	3.1m	5.3m	2.3m	0.0m	0.0m	0.0m	5.4m	1.8m
9	NE	2.4m	1.7m	3.1m	5.3m	2.3m	-0.5m	0.0m	0.0m	5.4m	0.0m
10	NW	0.9m	1.5m	0.0m	0.0m	0.0m	0.0m	2.3m	1.9m	2.3m	1.9m
11	SW	2.4m	1.7m	3.1m	5.3m	2.3m	0.0m	5.4m	0.0m	0.0m	0.0m
12	SW	2.4m	0.5m	3.1m	5.3m	2.3m	-1.8m	5.4m	1.8m	0.0m	0.0m
19	NE	2.4m	0.5m	0.0m	0.0m	0.0m	0.0m	0.0m	0.0m	3.3m	2.4m
20	NE	2.4m	1.7m	0.0m	0.0m	0.0m	0.0m	0.0m	0.0m	3.3m	0.7m
21	NW	2.1m	1.8m	0.0m	0.0m	0.0m	0.0m	3.2m	0.5m	0.0m	0.0m
24	SE	2.1m	2.8m	0.0m	0.0m	0.0m	0.0m	0.0m	0.0m	1.8m	5.8m
25	SE	1.4m	0.6m	0.0m	0.0m	0.0m	0.0m	0.0m	0.0m	1.8m	2.9m
26	SE	2.1m	0.9m	0.0m	0.0m	0.0m	0.0m	0.0m	0.0m	1.8m	0.6m
27	NE	2.1m	1.2m	0.0m	0.0m	0.0m	0.0m	10.0m	0.1m	0.0m	0.0m
28	SE	0.6m	2.0m	0.0m	0.0m	0.0m	0.0m	0.0m	0.0m	1.5m	2.7m
29	SE	0.6m	0.8m	0.0m	0.0m	0.0m	0.0m	0.0m	0.0m	1.5m	0.3m

Zoning Details

Is there Cross Flow Ventilation ?

Good

Air Leakage Details

Location

Suburban

Is there More than One Storey ?

No

Is the Entry open to the Living Area ?

Yes

Is the Entry Door Weather Stripped ?

Yes

Area of Heavyweight Mass

0m²

Area of Lightweight Mass

0m²

	<u>Sealed</u>	<u>UnSealed</u>
Chimneys	0	0
Vents	0	0
Fans	3	0
Downlights	0	0
Skylights	0	0
Utility Doors	0	3
External Doors	2	1

Unflued Gas Heaters

0

Percentage of Windows Sealed

98%

Windows - Average Gap

Small

External Doors - Average Gap

Small

Gaps & Cracks Sealed

Yes

Rater Comments

House Details

ClientName	Francesca Sfyrakis
HouseTitle	Block 46 Section 82
StreetAddress	3 Scott Street
Suburb	Narrabundah
Postcode	2604
AssessorName	Kelly Hill
FileCreated	14-07-2026

Rater Comments

MEASUREMENTS USED IN THIS ASSESSMENT

The Energy Rating recorded in this assessment is determined by assessing many elements of the structure and interior treatments including window and floor coverings. The area of external walls and windows, ceiling and floors are part of the assessment.

Some measurements used in this assessment may be nominal. Every effort is made by the assessor to accurately calculate the dimensions of property. However, often accurate and comprehensive plans indicating all dimensions of an existing property, particularly following alterations and extensions are not always available. The reader of this report should not rely on the accuracy of any dimensions used when making critical decisions relating to those dimensions. The assessor will not accept any liability should any discrepancy be revealed.

DESIGN OPTIONS

The design option suggestions to improve this energy rating may be additional to elements already in place. For example, the option to install 'Heavy Drapes and Pelmet' will take into account windows that already have Heavy Drapes and Pelmet installed. Insulation recommendations will take into account existing insulation values.

Some recommendations for improvement will not be practical in all circumstances. For example, if the dwelling is built on a concrete slab, it will be possible to install floor insulation.

DOOR SEALS AND WEATHER STRIPS

A wooden framed door is only considered to be sealed when a draft extruding device is fitted to the bottom of the door AND sealing tape or felt is fitting to the timber frame around the door opening.

WINDOW GLAZING RATIOS

Glazing areas in one direction greater than 25% of the nett conditioned floor area will reduce the Energy Efficiency Rating.

CONVEYANCING BUILDING FILE INDEX

SUBURB: **NARRABUNDAH** SECTION: **82** BLOCK: **46** UNIT: **N/A** EX GOV: **NO**

COU ISSUED Y/N	PLAN NUMBER	FOLIO NO.	DESCRIPTION OF WORK	AMEND	DETAILS	PERMIT NUMBER	COU PLAN NO. & DATE
Y	082818/A	-	DEMOLITION OF RESIDENCE			082818/A	
		-					082818/A 04/05/2009
Y	091375/A	-	NEW RESIDENCE & GARAGE			091375/A	
Y	091375/B	-		Y			
		-					091375/A/B 04/05/2009
Y	101668/A	-	PERGOLA			101668/A	
		-					101668/A 11/10/2010

For any incomplete approvals please email acbuildingconveyance@act.gov.au for further information on how to complete.

Drainage Plan Number: 3784

Survey: Y (1)

Comments:

CONVEYANCING PART 2

No information is provided in respect of electrical, drainage or sewer matters and or to the location of overhead power lines or underground cables in relation to the building.

	<u>Yes</u>	<u>No</u>
1. (a) Is this a government or ex government house?	☐	☒
(b) If yes, is there a building file with approvals on it?	☐	☐
2. Is there any record of incomplete building work on the building file?	☐	☒
If yes - file copies attached		
3. Are there any records on the building file of current (within 5 years) housing Indemnity insurance policies for building work? If yes - file copies attached	☐	☒
4. Are there any records on the building file showing building applications still being processed? (Current within 3 years) If yes - file copies attached	☐	☒
5. Are there any records on the building file in relation to loose-fill asbestos insulation?	☐	☒
If available, copies of the following documents are provided:		
• Certificate/s of Occupancy and Use	☒	☐
• Survey Certificates	☒	☐
• Unit Plan/Unit Entitlements (if property is unit titled)	☐	☒
• Approved Building Plans	☒	☐
• Ex- government Building Plans*	☐	☒
If requested:		
• Drainage Plan(s)	☒	☐

ASBESTOS

The ACT Government is not able to guarantee the accuracy of the information in this report.

You should make your own enquiries and obtain reports (from a licensed Asbestos Assessor) in relation to the presence of loose fill asbestos insulation (and other forms of asbestos) on the premises. For more information go to the Asbestos Awareness Website –

www.asbestos.act.gov.au

Please note: Development Approval plans will not be included in this report (We do not receive Development Approval Plans unless they are part of a Building Approval in which case they become Building Approval Plans), if development approval was granted you can request copies of the Development Approval plans from ACEPDcustomerservices@act.gov.au.

Please Note: Building approvals that have been generated via eDevelopment will be issued with a project number prefixed by the letter B. Initial building approval documentation will be identified with project number B20XXXX only but will be referenced as B20XXXX/A on the Certificate of Occupancy and Use. Any amendments to the original approval will be issued with the project number and an alphanumeric digit. The first amendment will be identified as B20XXXX/B, the second amendment B20XXXX/C etc. Not all eDevelopment plans will be stamped with the plan number.

***Ex Government plans:** Plans are typical and not specific to each residence. There may be slight changes to the layout or window locations that were not required to be approved.

Search officer comments (if any?)

Search officer initials: Ashleigh

Cost of application: \$ 144.79

Date completed:

02/07/2026

YK Developments Pty Ltd
PO Box 339
MAWSON ACT 2607

Dear Sir

As instructed, we have surveyed land at Narrabundah, in the Division of Narrabundah, District of Canberra Central, having a total frontage of 17.135 metres to Scott Street, being **Block 46 Section 82 Deposited Plan Numbered 824** as shown in the sketch plan below.

Upon this land stands the brick foundation of a building in the course of erection to be on completion a cottage residence.


The sketch shows the position of the foundation relative to the boundaries.

Other than as stated or referred to above, there are no apparent encroachments upon this land or by this property on adjoining lands or street.

Yours faithfully
M & S SURVEYS PTY LTD

P. Selfe

Peter Selfe
Registered Surveyor

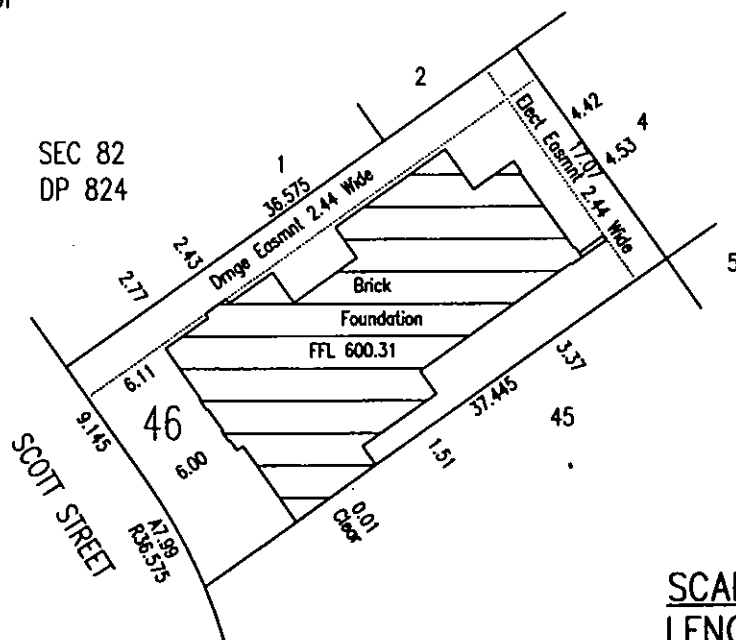

SCALE 1:500
LENGTHS ARE IN METRES



**ACT Building, Electrical and Plumbing Control**

GPO Box 1908, Canberra ACT 2601

Certificate of Completion of Demolition

Certificate No. **082818N1C1**

This Certificate is issued in accordance with Section 71 (2) of the Building Act.

The demolition of building work listed on this certificate has been completed in accordance with the prescribed requirements.

Builder ANDREW JOHN IRWIN	Suburb NARRABUNDAH	Section 82	Block 46
Notice of Intention to Start Work Number 082818N1	Plan 082818/A		

Building Work

Nature of Work	Project Item Description	Unit	Other Description	Class of Occupancy	Type of Construction
DEMOLITION	RESIDENCE			1a (i)	NA

Comments

Important note:

The issue, under this Part, of a certificate in respect of a building or portion of a building does not affect the liability of a person to comply with the provisions of a law of the Territory (including this Act) relating to the building or portion of the building.

SARAH RADFORD
Delegate of the Registrar

4/5/2009
Date



Irwin & Hartshorn Pty Ltd

abn 69 074 330 082

12 alderson place
hume act 2620

phone 02 6260 1588
fax 02 6260 1236

SHEET No 1 OF 3

DEMOLITION WORK PLAN FOR

BLOCK: 46 SECTION: 82 SUBURB: NARRABUNDAH

Street address: 3 SCOTT STREET

Number of buildings to be demolished: ONE + GARAGE

Height: Approx: 6.2m

Distance from closest boundary: Approx. 3.5 metres

Main materials of construction: Brick, concrete & timber

Plan No: 082818-A
28 JUL 2008
RECEIVED
ACT Planning & Land Authority

PROCEDURES


- Power supply to the site will be disconnected at the main by ACTEW/AGL
- Gas supply will be terminated outside the boundary by ACTEW/AGL
- A licenced remover will remove and dispose of all asbestos sheeting in accordance with NOHSC 2002:2005 second edition
- A licenced drainer will plug the sewer before being inspected by ACTEW/AGL
- Water will be used for dust suppression before being disconnected at meter
- All new workers to Irwin & Hartshorn will be inducted on site
- All demolition work will be in accordance with the AS 2601 code
- One day is allowed for each major activity, 7 days for completion of the demolition

METHOD


- Strip by hand all material to be salvaged
- Using a hydraulic excavator fold building to middle and load all rubble onto tipping trucks to be recycled where possible or tipped at an approved site
- Exhume all concrete footings with hydraulic excavator then transport to Canberra Concrete Recyclers for processing
- Clean and level site on completion

SAFETY PROCEEDURES

- Any work above 1.8m will be done in accordance with appropriate code
- A mobile telephone will be available on site at all times
- Appropriate safety equipment will be worn at all times
- A 1.8m high chain wire fence will be erected around the site to prevent any unauthorised entry


Andrew Irwin

Licence No. 200012208

BUILDING APPROVAL
Issued under s.28 of the
Building Act 2004.
JOSEPH FEKETE
Certifier Name
200016267
Licence Number
30/6/08
Issue Date

Certifier Signature

demolitionexcavationplanthirebuikhaulage
generalhaulageheavyhaulagetilttrayhireoverdimensiontransport

WASTE MANAGEMENT PLAN — PART 3

DEMOLITION WASTE PROFORMA

Unit No:

Block: 46

Section: 82

Suburb: NARRABONDATT

Applicant's Name:

Applicant's Signature:

Date: / /

Demolisher Assigned: IRWIN & HARTSHORN P/L

Demolisher's Signature:

ACT Builder's Licence No. 67

BUILDING APPROVAL		DISPOSAL AT LANDFILL	
Issued 10 Oct 2004	Building Act 2004	Disposal Name	Disposal Number
DEPH FEKETE		108016267	300804
Date		Date	
Signature		Signature	

Type Of Material Generated	Estimated Volume Of Material Generated (m³)	Estimated Volume (m³)	REUSE/RECYCLING OF DEMOLITION WASTE		Estimated Volume (m³)	Specify name of receiving recycling outlet(s) and/or reuse site(s)	Estimated Volume (m³)	Specify landfill site(s)
			ON-SITE	OFF-SITE				
Excavation Material			Plan No. 082818-A 28 JUL 08 RECEIVED ACT Planning & Land Author					
Green Waste								
Bricks	22			22	CANBERRA CONCRETE RECYCLERS			
Concrete	14			14	C.C.R			
Timber (Please Specify)	4			2	TIMBER RECYCLER	2	C.C.R	
Plasterboard/Gyprock	3					3	C.C.R	
Metals (Please Specify)								
Other (Please Specify)								
TOTAL	43			38		5		

**ACT Building, Electrical and Plumbing Control**

GPO Box 1908, Canberra ACT 2601

Certificate of Occupancy and Use

Certificate No. **091375N1C1**

This Certificate is issued in accordance with Section 69 (2) of the Building Act.

The building work listed on this certificate has been completed substantially in accordance with the prescribed requirements and is considered fit for occupation and use.

Builder DENNIS ILIJA KATAVIC	Suburb NARRABUNDAH	Section 82	Block 46
Notice of Intention to Start Work Number 091375N1	Plans 091375/A /B		

Building Work

Nature of Work	Project Item Description	Unit	Other Description	Class of Occupancy	Type of Construction
NEW STANDARD	RESIDENCE		INCLUDING GARAGE	1a (i)	NA

Comments**Important note:**

1. Residential building statutory warranties and residential insurance apply in relation to building work.
2. The issue, under this Part, of a certificate in respect of a building or portion of a building does not affect the liability of a person to comply with the provisions of a law of the Territory (including this Act) relating to the building or portion of the building.

SARAH RADFORD
Delegate of the Registrar

4/5/2009
Date

ACT HOUSE ENERGY RATING SCHEME

6 points 5 stars

12 DEC 2007

ALEX KWONG

01-0082

FirstRate Assessor

SHEET No 2 OF 7

APPROVAL AMENDED

PURSUANT TO SECTION 198
IN RESPECT OF THE NOMINATED
AMENDMENTS ONLY





Delegate name JOANNA TEMPLE

Date 27.8.2008

Plan No: 09135/A

23 APR 2009

RECEIVED
ACT Planning & Land Authority

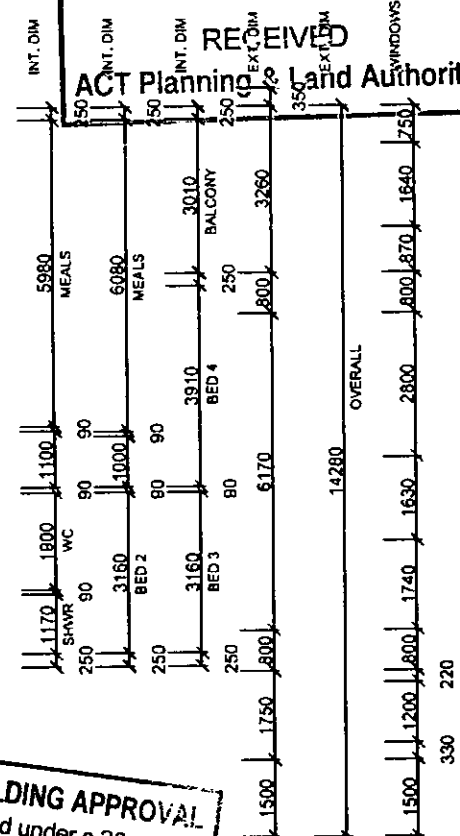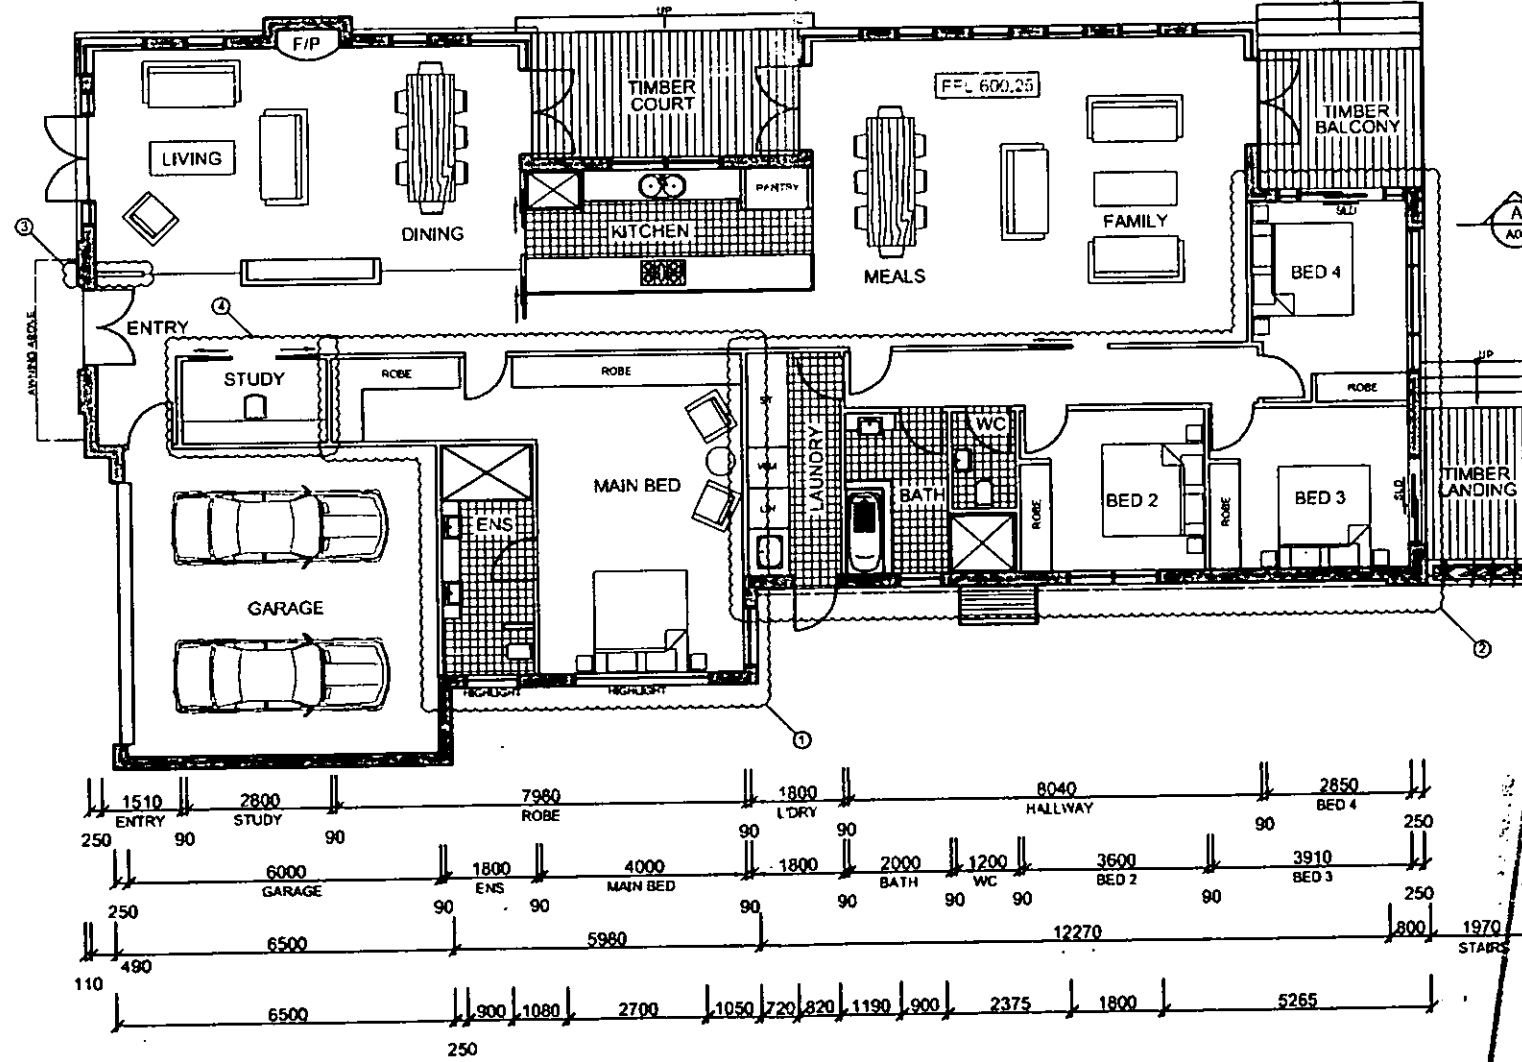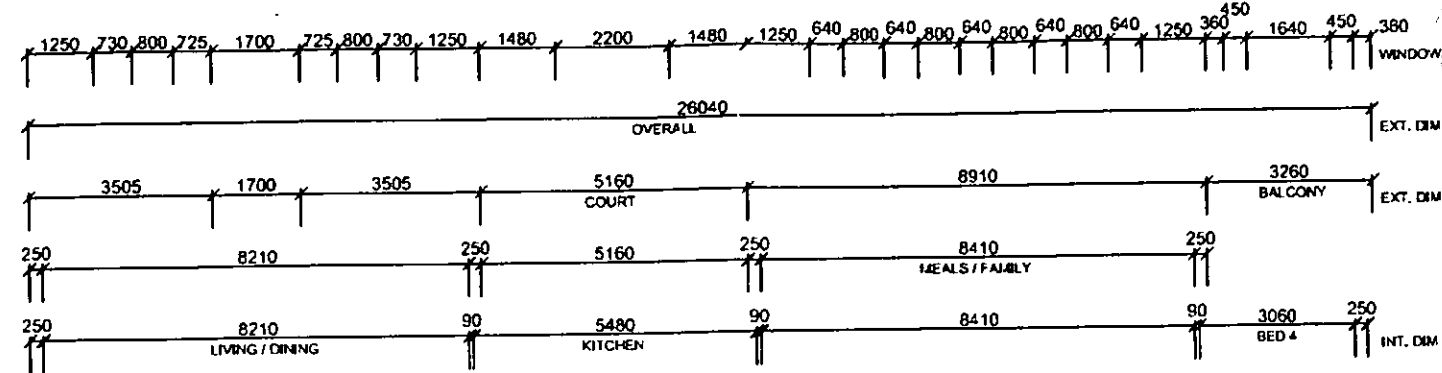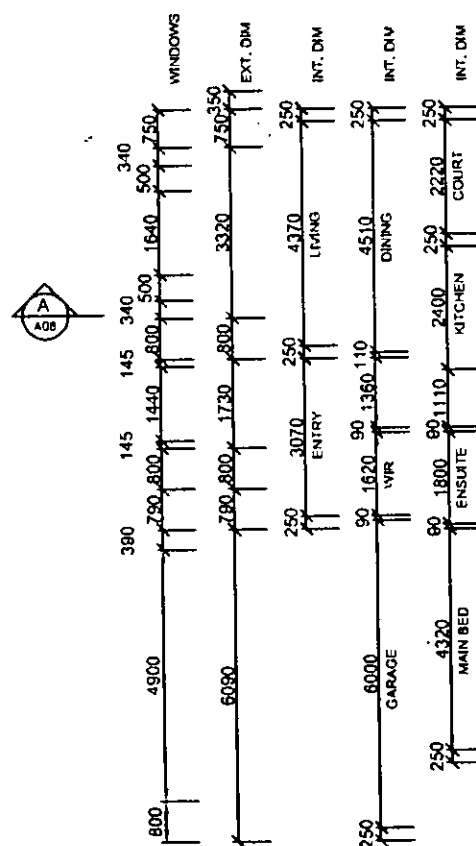

GROUND FLOOR PLAN
SCALE 1:100

BUILDING APPROVAL
Issued under s.28 of the
Building Act 2004.
JOSEPH FEKETE
INT. DIM. Certifier Name
200016267
EXT. DIM. Licence Number
8.1.8.19
Issue Date
Certifier Signature

© COPYRIGHT ARCHITECTS RING & ASSOC. PTY LTD. 2008

NOTE:
CONTRACTOR MUST VERIFY ALL DIMENSIONS ON
SITE BEFORE COMMENCING ANY WORK OR DRAWING
SHOP DRAWINGS. DO NOT SCALE DRAWINGS.

GENERAL NOTES:

ALL WORK TO BE CONSTRUCTED IN ACCORDANCE WITH
RELEVANT AUSTRALIAN STANDARDS, BUILDING CODE OF
AUSTRALIA AND LOCAL AUTHORITY'S REGULATIONS. ERE OUT
ALL WORK IN THE BEST AND MOST TRADESMAN LIKE MANNER
AND TO THE SATISFACTION OF THE SUPERINTENDENT.
ALL DIMENSIONS ARE IN MILLIMETERS UNLESS OTHERWISE
NOTED.

Date	No	Amendments	Code
24.08.07	1	RE-LOCATE TO ACT/PLA	A
24.08.07	2	RE-LOCATE TO ACT/PLA	A
24.08.07	3	RE-LOCATE TO ACT/PLA	A
30.08.08	1	MAIN BED RE-LOCATED	B
	2	LAUNDRY, BATH, BED 3, BED 4 AND BED 4 RE-LOCATED	B
	3	STUDY ADDED	B
	4	RE-LOCATED	B



ARCHITECTS
RING & ASSOCIATES
ARCHITECTS INTERIOR DESIGN
11 LEITCH STREET, GUNNATHAM, ACT 2608
PH: 02 6209 7177 FAX: 02 6209 7178
ARCHITECTS RING AND ASSOCIATES PTY LTD

PROJECT
NEW HOME

CLIENT
WILSON

PROJECT MANAGER
XX
BLOCK SECTION DIVISION
46 62 NARRABUNDIAH
DRAWING TITLE
BASEMENT FLOOR PLAN

DATE SCALE DRAWN CHECKED
NOV.07 (A2) 1:100 EK TERRY
JOB NO. DWG NO. CODE
0766 A04 B

FILE NAME:

ACT HOUSE ENERGY
RATING SCHEME

6 points 5 stars

12 DEC 2007

ALEX KWONG

01-0060


Alex Kwong
Principal Assessor

PLANNING AND DEVELOPMENT ACT 2007
APPROVAL AMENDED
PURSUANT TO SECTION 198
IN RESPECT OF THE NOMINATED
AMENDMENTS ONLY

Delegate name JOANNA TEMME

Date 27 & 28/08

2050 50 250
WINDOWS
2700
FCL 602.95
FFL 600.25
BOUNDARY

 **NORTH EAST ELEVATION**
SCALE 1:100

4000L ABOVE GROUND WATER TANK

PLANTER BOX
SHEET No 3 OF 7

3" FALL METAL SHEETING OVER
TIMBER ROOF TRUSSES
TO MANUFACTURER'S SPECIFICATION
WITH R4.0 CEILING INSULATION


250mm BRICK VENEER WALLS WITH
R2.0 WALL INSULATION

STEEL AWNING TO ARCHITECT'S SPECIFICATIONS

BRICK CHIMNEY

ANODISED ALUMINIUM IMPROVED PC
WINDOW & DOOR FRAMES

STEEL BALUSTRADE

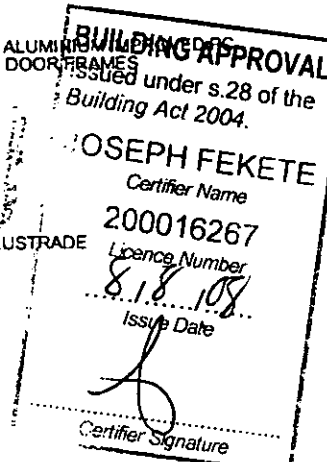

STEEL AWNING TO ARCHITECT'S SPECIFICATIONS

3" FALL METAL SHEETING OVER
TIMBER ROOF TRUSSES
TO MANUFACTURER'S SPECIFICATION
WITH R4.0 CEILING INSULATION

BRICK CHIMNEY

ANODISED ALUMINIUM IMPROVED PC
WINDOW & DOOR FRAMES

250mm BRICK VENEER WALLS WITH
R2.0 WALL INSULATION

Plan No: 0913-T/A

PLANTER BOX

23 APR 2009

RECEIVED
ACT Planning & Land Authority

2700
FCL 602.95
FFL 600.25
BOUNDARY

GARAGE WALL ON
BOUNDARY LINE

600
1350
735 770 735
30 30 50
WINDOWS

2700
FCL 602.95
FFL 600.25
BOUNDARY

 **SOUTH EAST ELEVATION**
SCALE 1:100

BRICK RETAINING WALL

© COPYRIGHT ARCHITECTS RING & ASSOC. PTY LTD. 2005
NOTE:

CONTRACTOR MUST VERIFY ALL DIMENSIONS ON
SITE BEFORE COMMENCING ANY WORK OR DRAWING
SHOP DRAWINGS. DO NOT SCALE DRAWING.

NORTH

Date	No	Amendments	Code
12.12.07		REVISED TO ACT/PLA	A
28.04.08		REVISED TO ACT/PLA	A
24.08.08		REVISED TO ACT/PLA	A
30.08.08	1	MAIN BED REVISED	B
	2	U LIFT WITH BED 1	
	3	BED 1 DOOR REVISED	
	4	BED 1 DOOR REVISED	
	5	WATER TANK REVISED	
	6	WATER TANK REVISED	
	7	WATER TANK REVISED	
	8	WATER TANK REVISED	
	9	WATER TANK REVISED	

GENERAL NOTES:

ALL WORK TO BE CONSTRUCTED IN ACCORDANCE WITH
RELEVANT AUSTRALIAN STANDARDS, BUILDING CODE OF
AUSTRALIA AND LOCAL AUTHORITIES REGULATIONS. EXECUTE
ALL WORK IN THE BEST AND MOST TRADESMANLIKE MANNER
AND TO THE SATISFACTION OF THE SUPERINTENDENT.
ALL DIMENSIONS ARE IN MILLIMETERS UNLESS OTHERWISE
NOTED.



ARCHITECTS
RING & ASSOCIATES
ARCHITECTS IN INTERIOR DESIGN
101 EPPING STREET, EPPING VIC 3103
PH: (03) 8230 7177 FAX: (03) 8230 7100 ACH008802067
ARCHITECTS RING AND ASSOCIATES PTY LTD

PROJECT

NEW HOME

CLIENT

WILSON

BLOCK

46

SECTION

82

DIVISION

NARRABUNDAH

DRAWING TITLE

NORTH EAST ELEVATION
SOUTH EAST ELEVATION

DATE	SCALE (A2)	DRAWN	CHECKED
NOV.07	1:100	EK CAD	TERRY RING

JOB NO.	DWG NO.	CODE
0766	A06	B

FILE NAME:

ACT HOUSE ENERGY
RATING SCHEME

6 points 5 stars

12 DEC 2007

ALEX KWONG 01-0089

FirstRate Assessor


LAND PLANNING AND ENVIRONMENT ACT 1991

APPROVAL GRANTED

PURSUANT TO SECTION 230
SUBJECT TO THE CONDITIONS SET OUT IN THE
SOURCE OF DECISION
PURSUANT TO SECTION 215


Delegate name: JOANNA HAMMILL

Date: 27.6.2008

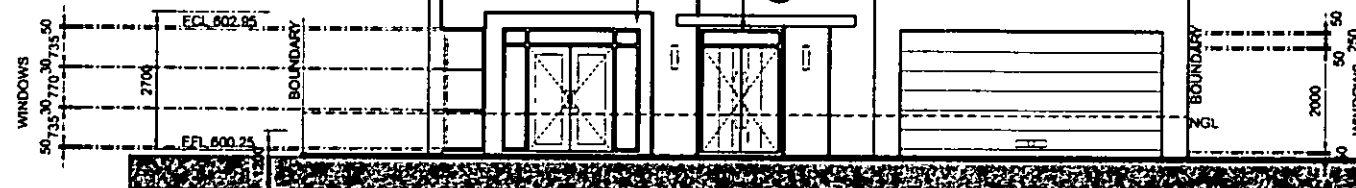

SOUTH WEST ELEVATION

SCALE 1:100

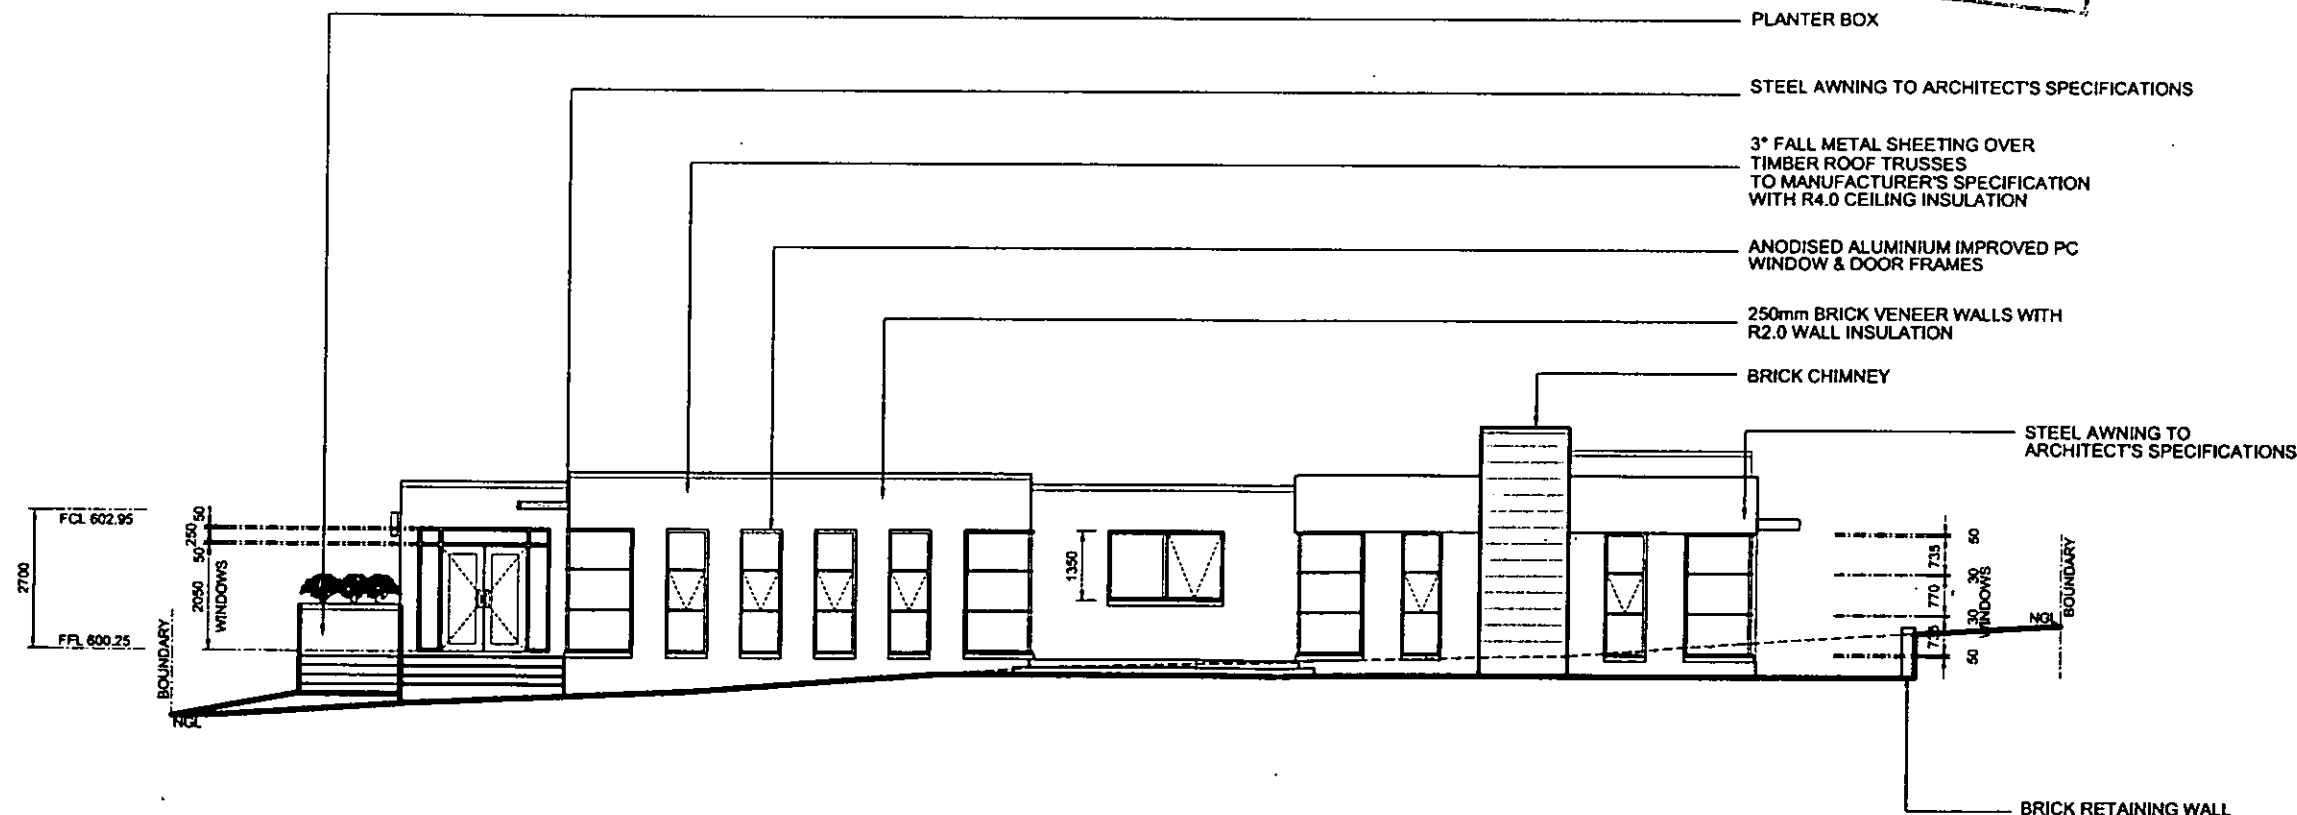

NORTH WEST ELEVATION

SCALE 1:100


BRICK CHIMNEY

3" FALL METAL SHEETING OVER
TIMBER ROOF TRUSSES
TO MANUFACTURER'S SPECIFICATION
WITH R4.0 CEILING INSULATION

250mm BRICK VENEER WALLS WITH
R2.0 WALL INSULATION

STEEL AWNING TO ARCHITECT'S SPECIFICATIONS

ANODISED ALUMINIUM IMPROVED PC
WINDOW & DOOR FRAMES

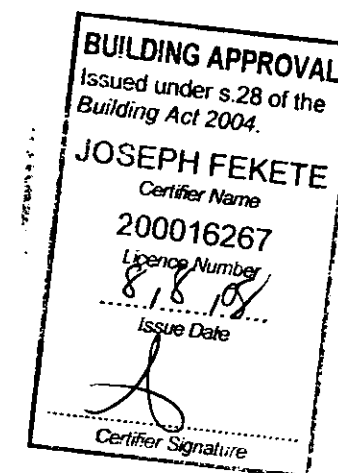

PLANTER BOX

STEEL AWNING TO ARCHITECT'S SPECIFICATIONS

3" FALL METAL SHEETING OVER
TIMBER ROOF TRUSSES
TO MANUFACTURER'S SPECIFICATION
WITH R4.0 CEILING INSULATION

ANODISED ALUMINIUM IMPROVED PC
WINDOW & DOOR FRAMES

250mm BRICK VENEER WALLS WITH
R2.0 WALL INSULATION

BRICK CHIMNEY

STEEL AWNING TO
ARCHITECT'S SPECIFICATIONS

BRICK RETAINING WALL

© COPYRIGHT ARCHITECTS RING & ASSOC. PTY LTD. 2006
NOTE:

CONTRACTOR MUST VERIFY ALL DIMENSIONS ON
SITE BEFORE COMMENCING ANY WORK OR DRAWING
SHOP DRAWINGS. DO NOT SCALE DRAWING.

NORTH

Plan No: 091375/A

23 APR 2009

Date	No	Amendments	Code
11.11.08	1	ISSUE TO ACTPLA	A-
08.04.09	2	RE-ISSUE TO ACTPLA	A-
08.04.09	3	RE-ISSUE TO ACTPLA	A2

ACT Planning & Local Authority

GENERAL NOTES:

ALL WORK TO BE CONSTRUCTED IN ACCORDANCE WITH
RELEVANT AUSTRALIAN STANDARDS, BUILDING CODE OF
AUSTRALIA AND LOCAL AUTHORITIES REGULATIONS. EXECUTE
ALL WORK IN THE BEST AND MOST TRADESMAN LIKE MANNER
AND TO THE SATISFACTION OF THE SUPERINTENDENT.
ALL DIMENSIONS ARE IN MILLIMETERS UNLESS OTHERWISE
NOTED.



ARCHITECTS
RING & ASSOCIATES
ARCHITECTS INTERIOR DESIGN

36 LEFFROY STREET, GRIFFITH, CANBERRA, 2603
PH: (02) 8578 7117 FAX: (02) 8578 7100 ACH006302967
ARCHITECTS RING AND ASSOCIATES PTY LTD

PROJECT

NEW HOME

CLIENT

WILSON

BLOCK

46

SECTION

82

DIVISION

NARRABUNDAH

DRAWING TITLE

SOUTH WEST ELEVATION
NORTH WEST ELEVATION

DATE	SCALE (A2)	DRAWN	CHECKED
NOV.07	1:100	EK CAD	TERRY RING

JOB NO.	DWG NO.	CODE
0766	A07	A2

FILE NAME:

ACT HOUSE ENERGY
RATING SCHEME
6 points 5 stars
12 DEC 2007
ALEX KWONG 01-0080

FirstRate Assessor

LAND-PLANNING AND ENVIRONMENT ACT 1991
APPROVAL GRANTED
 PURSUANT TO SECTION 246
 SUBJECT TO THE CONDITIONS SET FORTH IN THE
 NOTICE OF DECISION
 PURSUANT TO SECTION 245

Delegate name: JOANNA HENRI
 Date: 27.6.2008

SHEET No 5 OF 7

© COPYRIGHT ARCHITECTS RING & ASSOC. PTY LTD. 2008
NOTE:
CONTRACTOR MUST VERIFY ALL DIMENSIONS ON
SITE BEFORE COMMENCING ANY WORK OR DRAWING
SET DRAWINGS. DO NOT SCALE DRAWING.

[illegible]

GENERAL NOTES:

ALL WORK TO BE CONSTRUCTED IN ACCORDANCE WITH RELEVANT AUSTRALIAN STANDARDS, BUILDING CODE OF AUSTRALIA AND LOCAL AUTHORITIES REGULATIONS. EXECUTE ALL WORK IN THE BEST AND MOST TRADESMAN LIKE MANNER AND TO THE SATISFACTION OF THE SUPERINTENDENT. ALL DIMENSIONS ARE IN MILLIMETERS UNLESS OTHERWISE NOTED.



**ARCHITECTS
RING & ASSOCIATES**
ARCHITECTS INTERIOR DESIGN

56 LEFROY STREET, GRIFFITH, CANBERRA,
PH. (02) 6239 7177 FAX (02) 6239 7100 ACNO0839
ARCHITECTS RING AND ASSOCIATES PTY LTD


PROJECT
NEW HOME
CLIENT
WILSON

BLOCK	SECTION	DIVISION
46	82	NARRABUNDAH

DRAWING TITLE
SECTIONS AA

DATE	SCALE (A2)	DRAWN	CHECKED
NOV.07	1:100	EK CAD	TERRY RING
JOB NO.	DWG NO.	CODE	
0768	A08	A2	

→

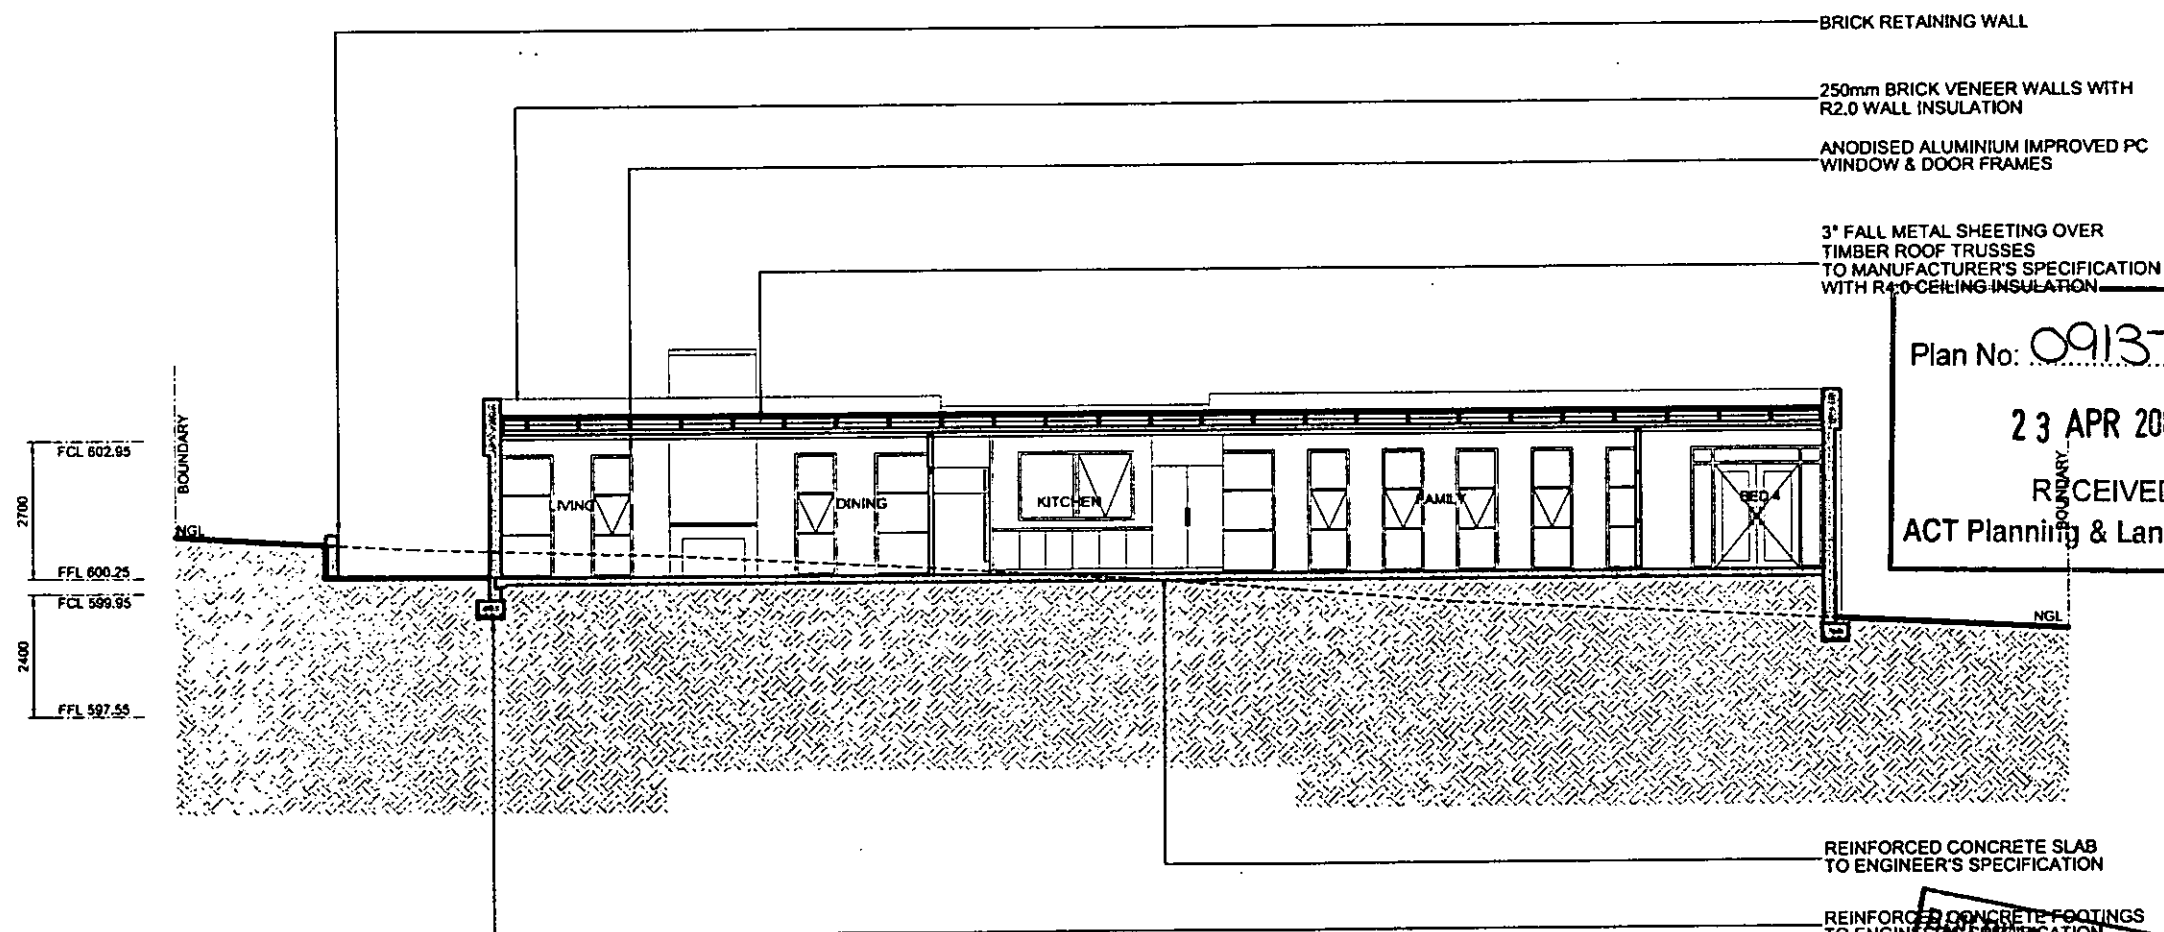

Plan No: 0913-TS/A
23 APR 2009
RECEIVED
ACT Planning & Land Authority

SECTION A-A
SCALE 1:100

REINFORCED CONCRETE FOOTINGS
TO ENGINEER'S SPECIFICATION

APPROVAL

Issued under s.28 of the
Building Act 2004.

JOSEPH FEKETE

Certifier Name

200016267

Licence Number


J. S. Fekete

Issue Date

Certifier Signature

NOTE. Chimney footing not to encroach into easement.

SHEET No 6 OF 7

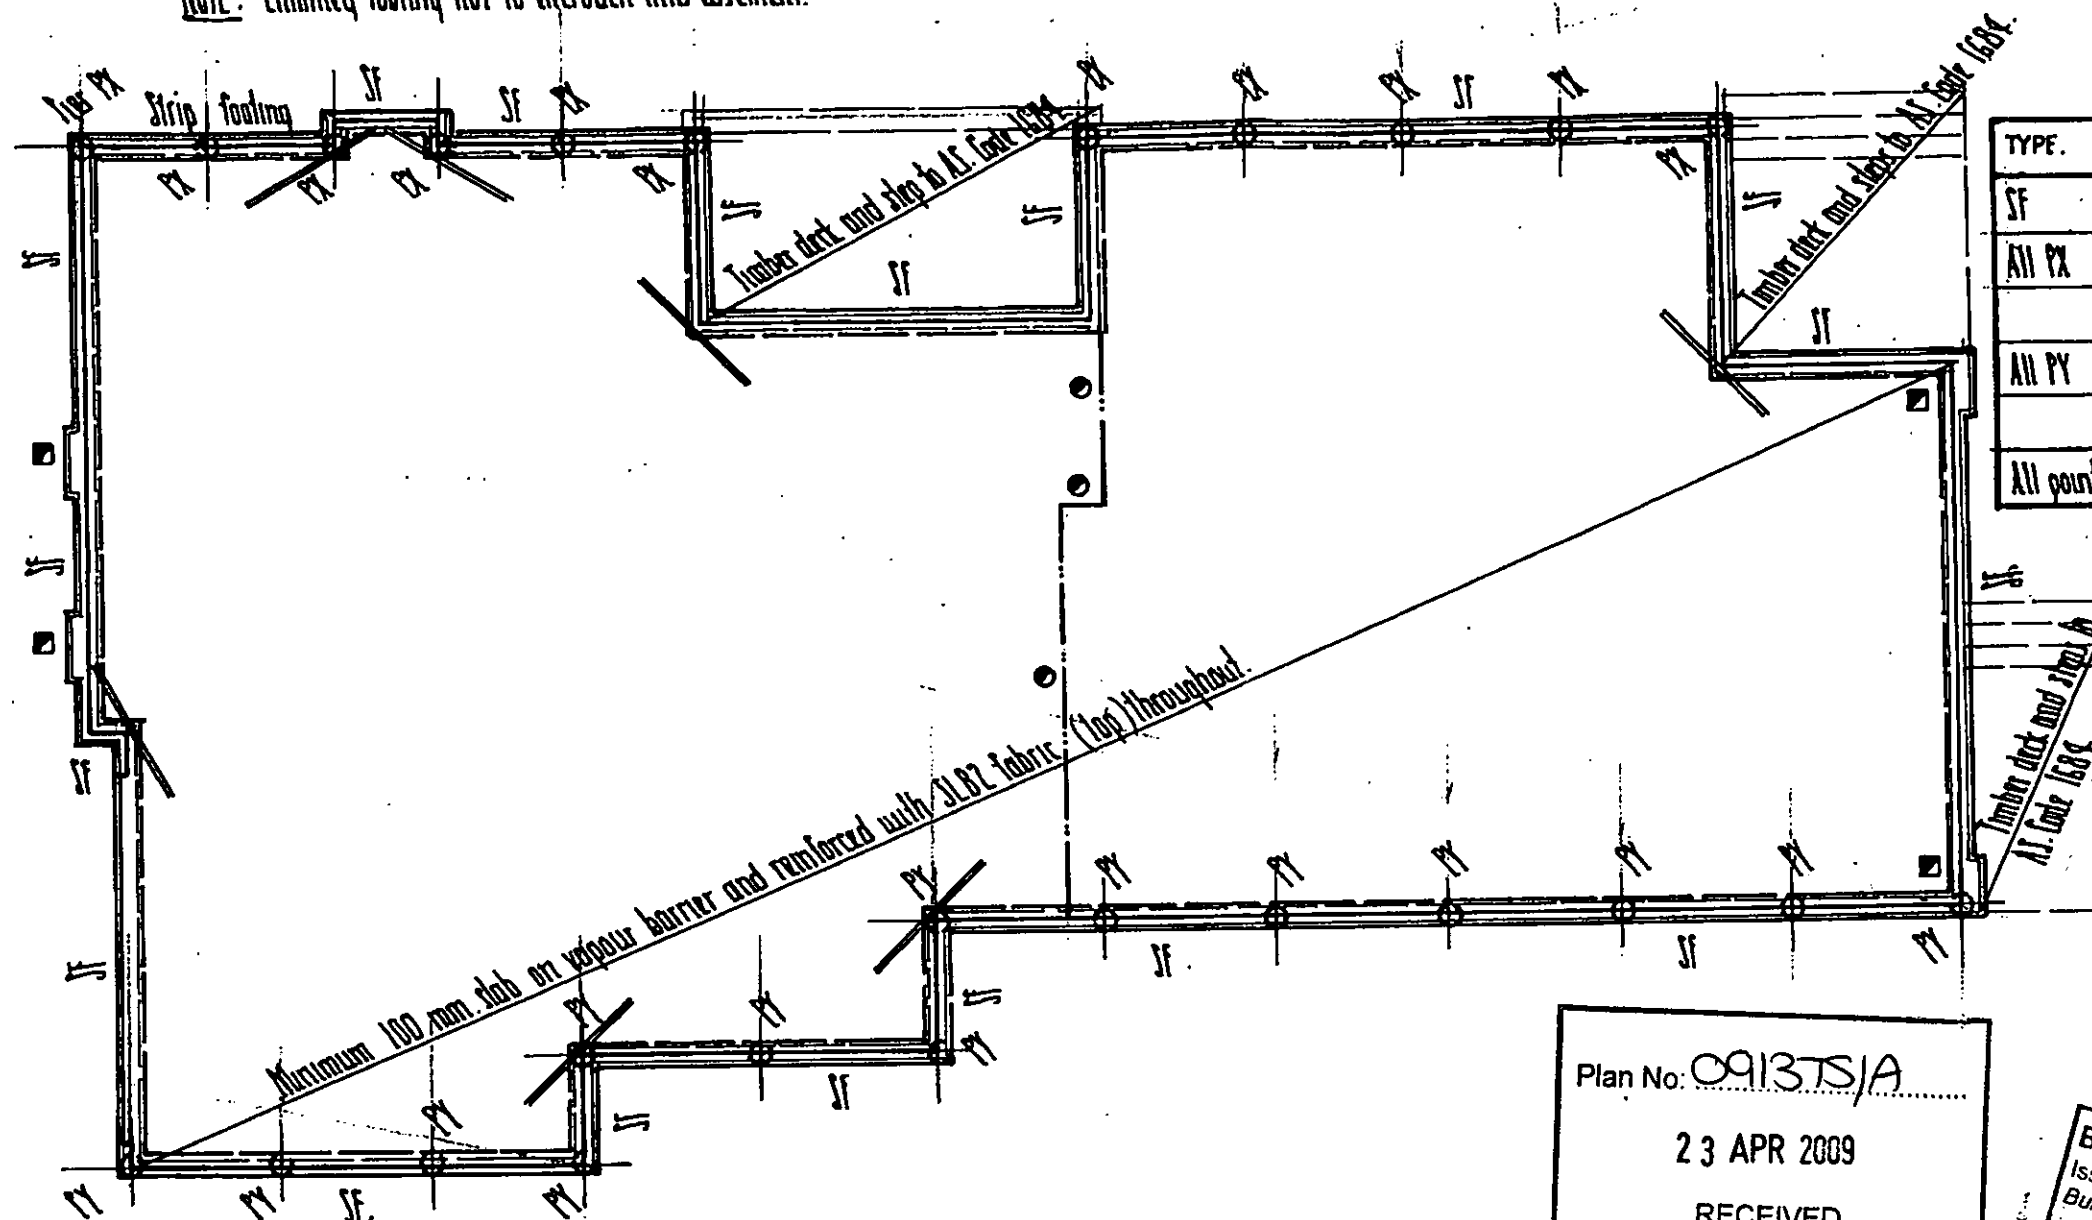

TYPE.	SIZE	REINFORCEMENT.
SF	300x500 mm(deep)	3 L12TM(top & btm.)
All PF	300 mm dia. at 2500 mm.	Down to upside of existing pipe excavation.
All PY	300 mm dia. at 2500 mm.	Down to bearing strata of 500 kPa
All points	400x500 mm deep	4 L12TM(top & btm.)

LAND (PLANNING AND ENVIRONMENT) ACT 1991
APPROVAL GRANTED
 PURSUANT TO SECTION 230
 SUBJECT TO THE CONDITIONS SET OUT IN THE
 NOTICE OF DECISION
 PURSUANT TO SECTION 245
 Delegate name JOANNA TEMME
 Date 27/6/2008

Plan No: 0913TS/A
 23 APR 2009
 RECEIVED
 ACT Planning & Land Authority

BUILDING APPROVAL
 Issued under s.28 of the
 Building Act 2004.
 JOSEPH FEKETE
 Certifier Name
 200016267
 Licence Number
 8.18.10
 Issue Date
 Certifier Signature

NOTE. Garage footing and piers not to encroach over boundary.

FOOTING and SLAB PLAN.

All strip footings designed for a "M" site classification.
 Site classification to be verified on site at time of footing excavations
 Recommend vertical articulation joints to all external brick walls in accordance with the Building Code of Australia.

Slab on ground as noted.
 All diagonal trimmers to be 2 N12 x 2000 mm long (very top)
 Points ● locate sawcut joint in top of slab.



sellick consultants
 po box 5005 braddon act 2612
 p: 02 6201 0200 f: 02 6247 2203
 sellickconsultants.com.au

DO NOT SCALE OFF DRAWINGS. VERIFY ALL DIMENSIONS ON SITE BEFORE COMMENCING WORK.
 COPYRIGHT: The concepts and information contained in this document are copyright of Sellick Consultants. Use or copying of the document in whole or in part without written permission constitutes an infringement of copyright.

PROJECT
 PROPOSED RESIDENCE
 BLOCK 46.
 SECTION 82.
 NARRABUNDAH. A.C.T.

CLIENT YK Developments. Pty. Ltd.

DESIGNED BY
 J.R.
 DRAWN BY
 J.T.
 AUTHORISED
 R.
 DATE June. 2008

TITLE
 Footing and slab plan.

FOR CONSTRUCTION

SCALE
 1:100, 1:20
 JOB NO.
 80419-S2.
 DRAWING NO.
 2/

ISSUE	DESCRIPTION	DATE	CHECKED
-------	-------------	------	---------

SHEET No 7 OF 7


LAND (PLANNING AND ENVIRONMENT) ACT 1981
APPROVAL GRANTED
 PURSUANT TO SECTION 230
 SUBJECT TO THE CONDITIONS SET OUT IN THE
 NOTICE OF DECISION
 PURSUANT TO SECTION 245
 Delegate name JOANNA TEMME
 Date 27/6/2008

BUILDING APPROVAL
 Issued under s.28 of the
 Building Act 2004.
JOSEPH FEKETE
 Certifier Name
 200016267
 Licence Number
 F.E. 18/08
 Issue Date
 Certifier Signature

Plan No: 091375/A

23 APR 2009

RECEIVED
 ACT Planning & Land Authority

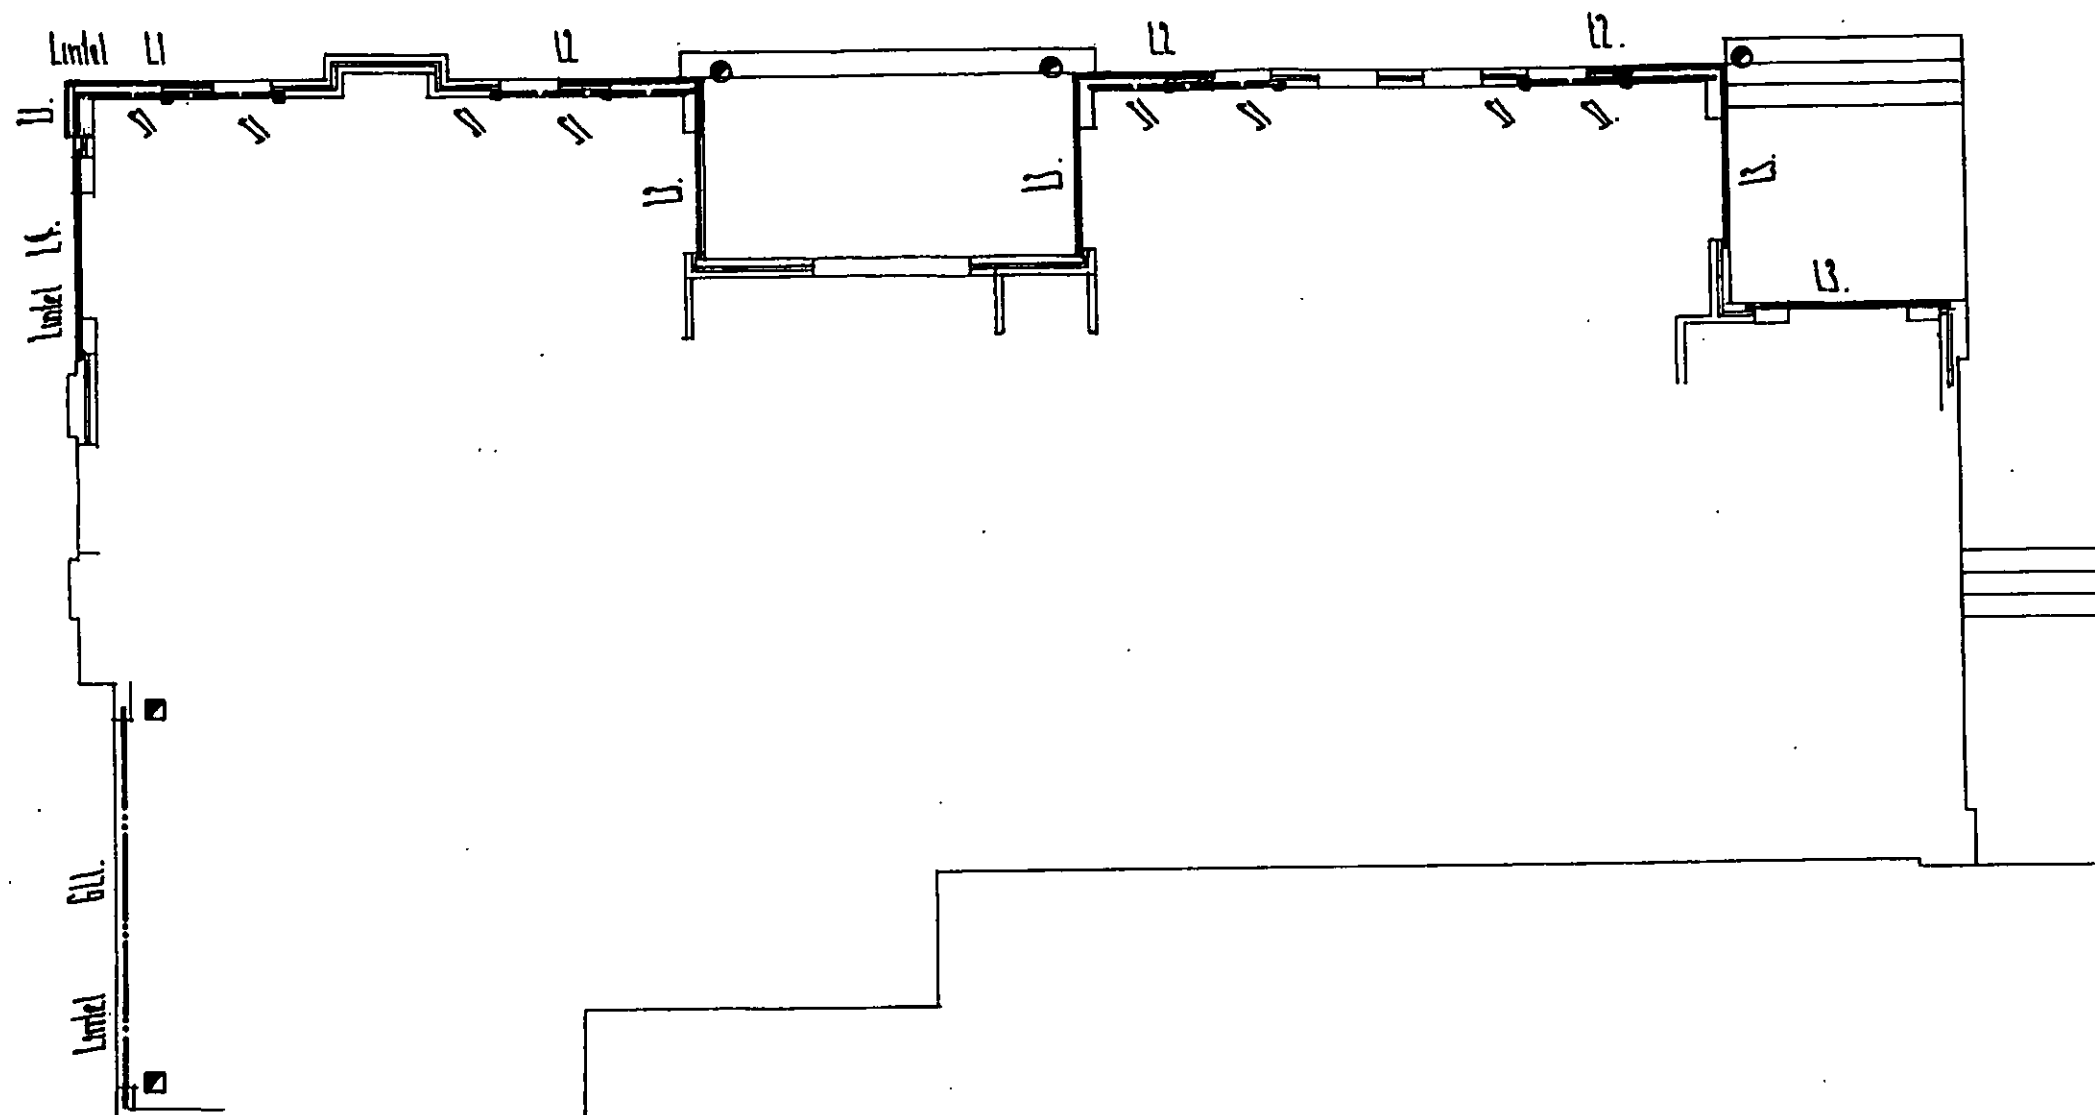

ROOF MARKING PLAN.

MEMBER SCHEDULE			
MARK	SIZE	REMARKS	DIAGRAM
All S1.	75x75x4-0 mm SHS.		
L1.	150PFC + 150x100x10 UA.	100 vert - stitch weld full length workshop fabricated as one.	1
All L2.	150PFC + 150x100x10 UA.	100 vert - stitch weld full length	1
L3.	150x100x10 UA.	150 vert. - stitch weld full length.	1
L4.	150x100x10 UA + 40x40x4 0 mm SHS.	150 vert. - stitch weld full length SHS to top of UA.	1
GL1.	250x10 vert.pl. + 200x10 hori.pl.	Stitch weld, both sides, full length.	1
●	Locates full site welding together of structural members after erection.		
■	Locates minimum 200 mm full bearing onto masonry - remainder 110 mm.		



sellick consultants
 po box 5005 braddon act 2612
 p: 02 6201 0200 f: 02 6247 2203
 sellickconsultants.com.au

DO NOT SCALE OFF DRAWINGS. VERIFY ALL DIMENSIONS ON SITE BEFORE COMMENCING WORK.
 COPYRIGHT: The concepts and information contained in this document are copyright of Sellick Consultants. Use or copying of this document in whole or in part without written permission constitutes an infringement of copyright.

PROJECT
 PROPOSED RESIDENCE.
 BLOCK 46.
 SECTION 82.
 NARRABUNDAH. A.C.T.

CLIENT YK Developments Pty.Ltd.

DESIGNED BY
 J.R.
 DRAWN BY
 J.T.
 AUTHORISED
 M
 DATE June.2008.

TITLE
 Roof marking plan.

FOR CONSTRUCTION

SCALE
 1:100, 1:20
 JOB NO.
 80419-S3.
 DRAWING NO.
 3 / 3

ISSUE	DESCRIPTION	DATE	CHECKED

PLOT RATIO = 47.8%

ALEX KWONG 01-0080

FirstRate Assessor

① F.F.L. CHANGED TO
SUIT SURVEYORS CERTIFICATE
F.F.L. 600-310

SHEET No OF ...

© COPYRIGHT ARCHITECTS RING & ASSOC. PTY LTD. 2006
NOTE:

CONTRACTOR MUST VERIFY ALL DIMENSIONS ON SITE BEFORE COMMENCING ANY WORK OR DRAWING SHOP DRAWINGS. DO NOT SCALE DRAWING.

NORTH

[illegible]

GENERAL NOTES:

ALL WORK TO BE CONSTRUCTED IN ACCORDANCE WITH RELEVANT AUSTRALIAN STANDARDS, BUILDING CODE OF AUSTRALIA AND LOCAL AUTHORITIES REGULATIONS. EXECUTE ALL WORK IN THE BEST AND MOST TRADESMAN LIKE MANNER AND TO THE SATISFACTION OF THE SUPERINTENDENT. ALL DIMENSIONS ARE IN MILLIMETERS UNLESS OTHERWISE NOTED.



**A R C H I T E C T S
R I N G & A S S O C I A T E S
A R C H I T E C T S I N T E R I O R D E S I G N**

56 LEFROY STREET, GRIFFITH, CANBERRA 2603
PH. (02) 62726 7177 FAX (02) 62726 7100 ACN006827667
ARCHITECTS RING AND ASSOCIATES PTYA LTD

PROJECT

NEW HOME

CLIENT

WILSON

BLOCK	SECTION	DIVISION
48	82	NARRABUNDAH

DRAWING TITLE

SITE PLAN

DATE	SCALE	DRAWN	CHECKED
NOV.07	(A2) 1:200	EK CAD	TERRY RING

JOB NO.	DWG NO.	CODE
0768	A03	A5

SCOTT STREET

SITE PLAN

SCALE 1:200

Plan No: 091375/B

- 1 MAY 2003

RECEIVED
ACT Planning & Land Authority

CLOTHESLINE

— PROPOSED BITUMEN DRIVEWAY

— 1.2m HIGH HEDGE

**ACT Building, Electrical and Plumbing Control**

GPO Box 1908, Canberra ACT 2601

Certificate of Occupancy and Use

Certificate No. **101668N1C1**

This Certificate is issued in accordance with Section 69 (2) of the Building Act.

The building work listed on this certificate has been completed substantially in accordance with the prescribed requirements and is considered fit for occupation and use.

Builder NATIONAL PATIOS PTY LTD	Suburb NARRABUNDAH	Section 82	Block 46
Notice of Intention to Start Work Number 101668N1	Plan 101668/A		

Building Work

Nature of Work	Project/Item Description	Unit	Other Description	Class of Occupancy	Type of Construction
OTHER	DA EXEMPT-SEE DESCRIPTION		PERGOLA	10a	NA

Comments**Important note:**

1. Residential building statutory warranties and residential insurance does not apply in relation to building work.
2. The issue, under this Part, of a certificate in respect of a building or portion of a building does not affect the liability of a person to comply with the provisions of a law of the Territory (including this Act) relating to the building or portion of the building.

SARAH RADFORD
Delegate of the Registrar

11/10/10
Date

ALL MEASUREMENTS TO BE CONFIRMED BY BUILDER PRIOR TO ORDERING OR FITTING OF ANY MATERIALS.
 ANY DISCREPANCIES TO BE REPORTED TO DESIGNER PRIOR TO COMMENCEMENT OF WORKS.
 ALL WORK IS TO BE CARRIED OUT IN ACCORDANCE WITH THE BUILDING CODES OF AUSTRALIA AND IN COMPLIANCE WITH THE RELEVANT AUSTRALIAN STANDARDS.
 DO NOT SCALE OFF DRAWINGS TO GAIN INFORMATION.
 BUILDER TO ENSURE DRAINAGE, SEWERAGE AND STORMWATER TIE LOCATION PRIOR TO COMMENCEMENT OF WORKS.

AREAS:

BLOCK ————— 626.5m²
 EXISTING RESIDENCE ————— 260.0m²
 EXISTING GARAGE ————— 39.6m²
 PROPOSED PERGOLA ————— 17.2m²

Erosion and sediment control:

This development will comply with the Environmental Protection Authority, Environmental Protection Guidelines for Construction and Land Development in the ACT, August 2007


Waste Management:

This development will comply with Territory and Municipal Services in accordance with the Development Control Code for Best Practise Waste Management in the ACT 1999

Landscape Management:

Trees and landscaping to be protected during construction where possible. Significant trees to be protected at all times during construction.

ZONE= RZ1:SUBURBAN



© COPYRIGHT

THIS PLAN REMAINS THE PROPERTY OF NATIONAL PATIOS, AND MAY NOT BE COPIED IN WHOLE OR IN PART WITHOUT WRITTEN PERMISSION.

PROJECT: PROPOSED PERGOLA:

BLOCK: 46 SECT: 82 Narrabundah




DISTRICT: CANBERRA CENTRAL

CLIENT: R & R Goldie of:

3 Scott Street Narrabundah

SCALE: 1:200 DWN: N.HILL



DATE: 01 Feb 10 SHEET: 1 OF 4

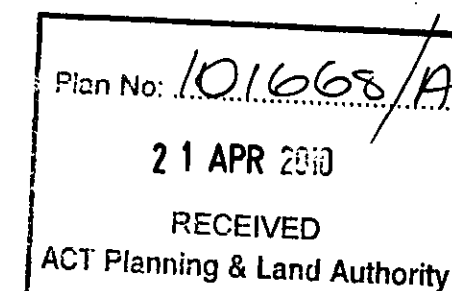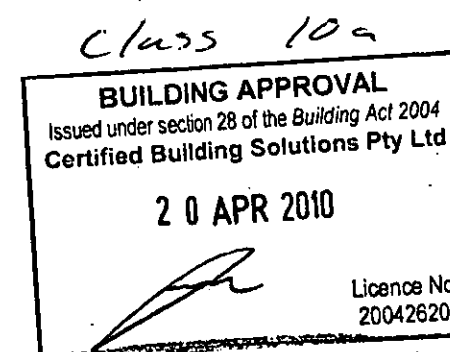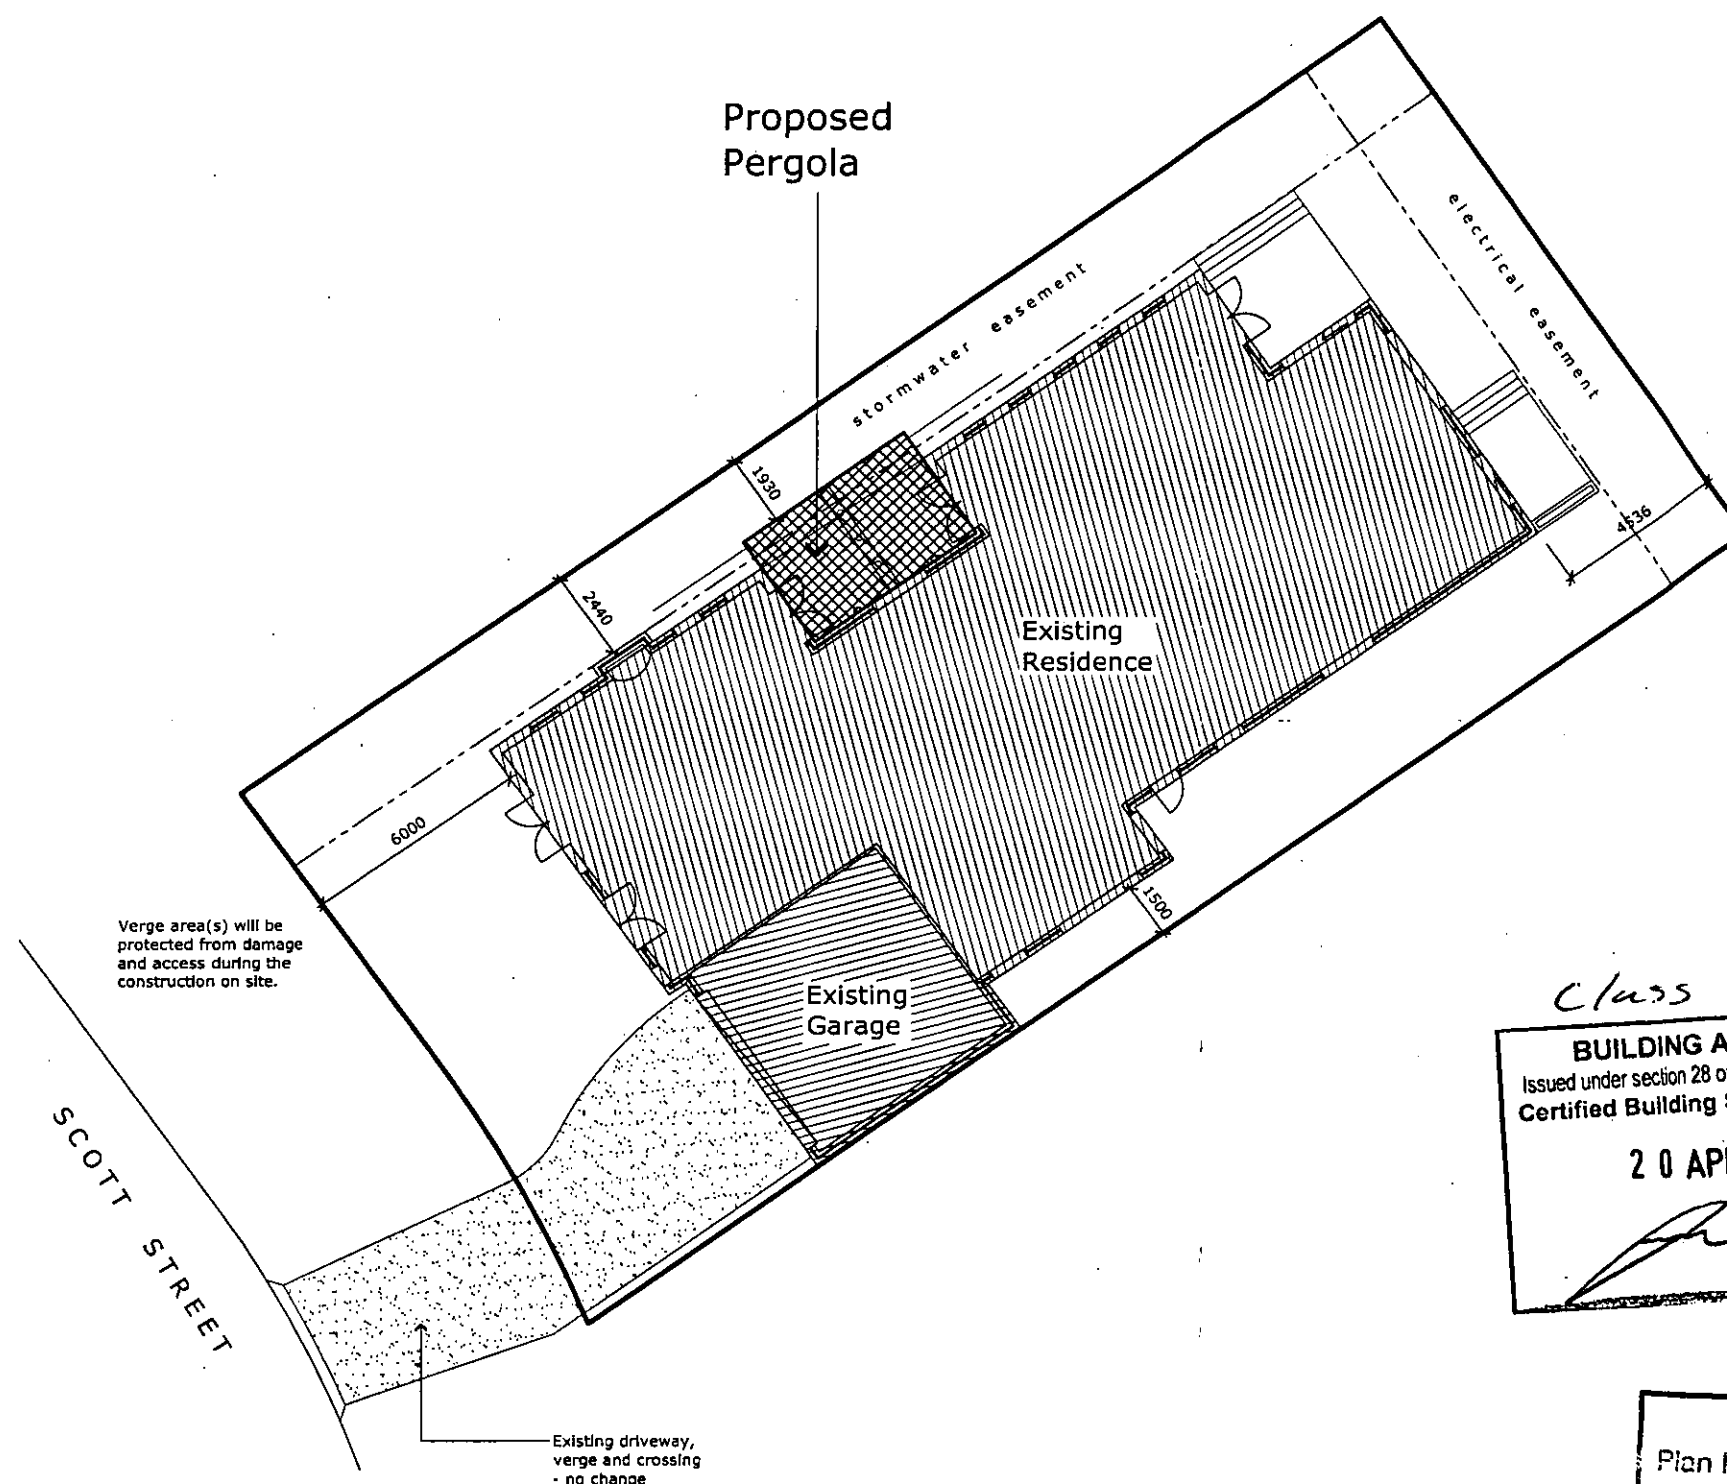

SITE PLAN

Pergola:

- 1 Proposed 2 bay open / close roof system as shown
- 2 Pergola height to be clear of 2 x existing 3020mm high downpipes
- 3 Pergola to be anchored entirely to 3 x existing residence walls / no posts required.
- 4 Framing to be steel
- 5 3 x downlights to be provided and installed down centre of pergola as shown and as indicated by the following symbol 

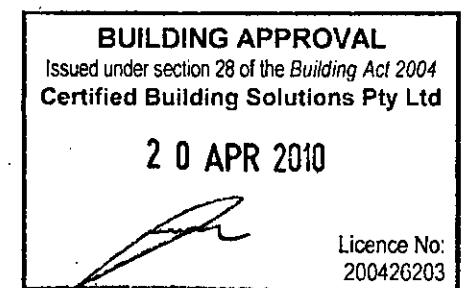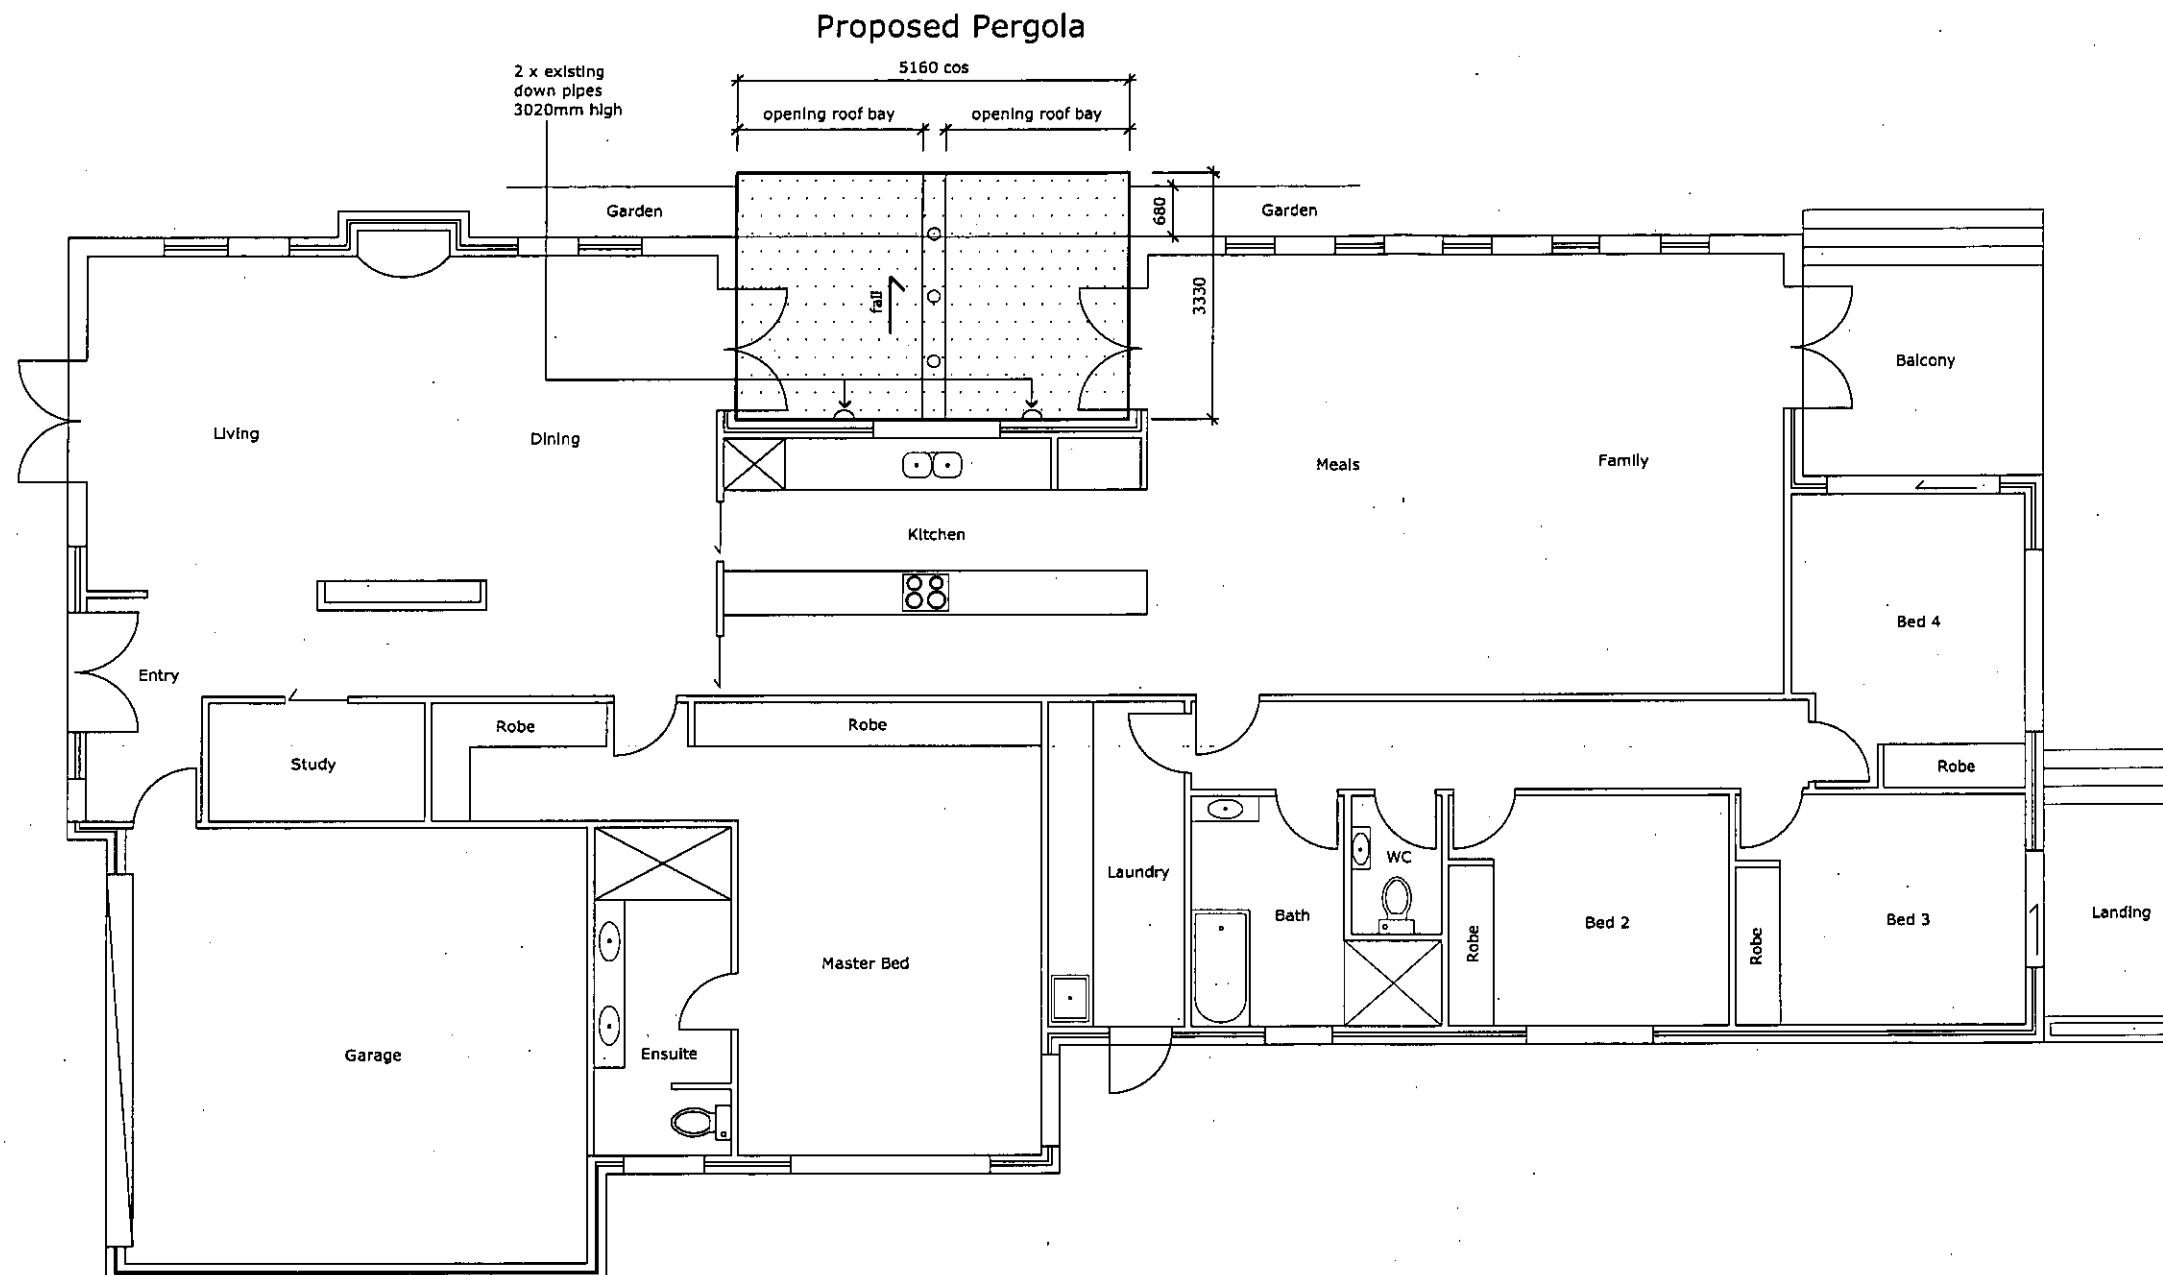


FLOOR PLAN

Plan No: 101668/A
21 APR 2010
RECEIVED
ACT Planning & Land Authority



© COPYRIGHT THIS PLAN REMAINS THE PROPERTY OF NATIONAL PATIOS, AND MAY NOT BE COPIED IN WHOLE OR IN PART WITHOUT WRITTEN PERMISSION.

PROJECT: PROPOSED PERGOLA:
BLOCK: 46 SECT: 82 Narrabundah
DISTRICT: CANBERRA CENTRAL
CLIENT: R & R Goldie of:
3 Scott Street Narrabundah
SCALE: 1:100 DWN: N.HILL
DATE: 01 Feb 10 SHEET: 2 OF 4

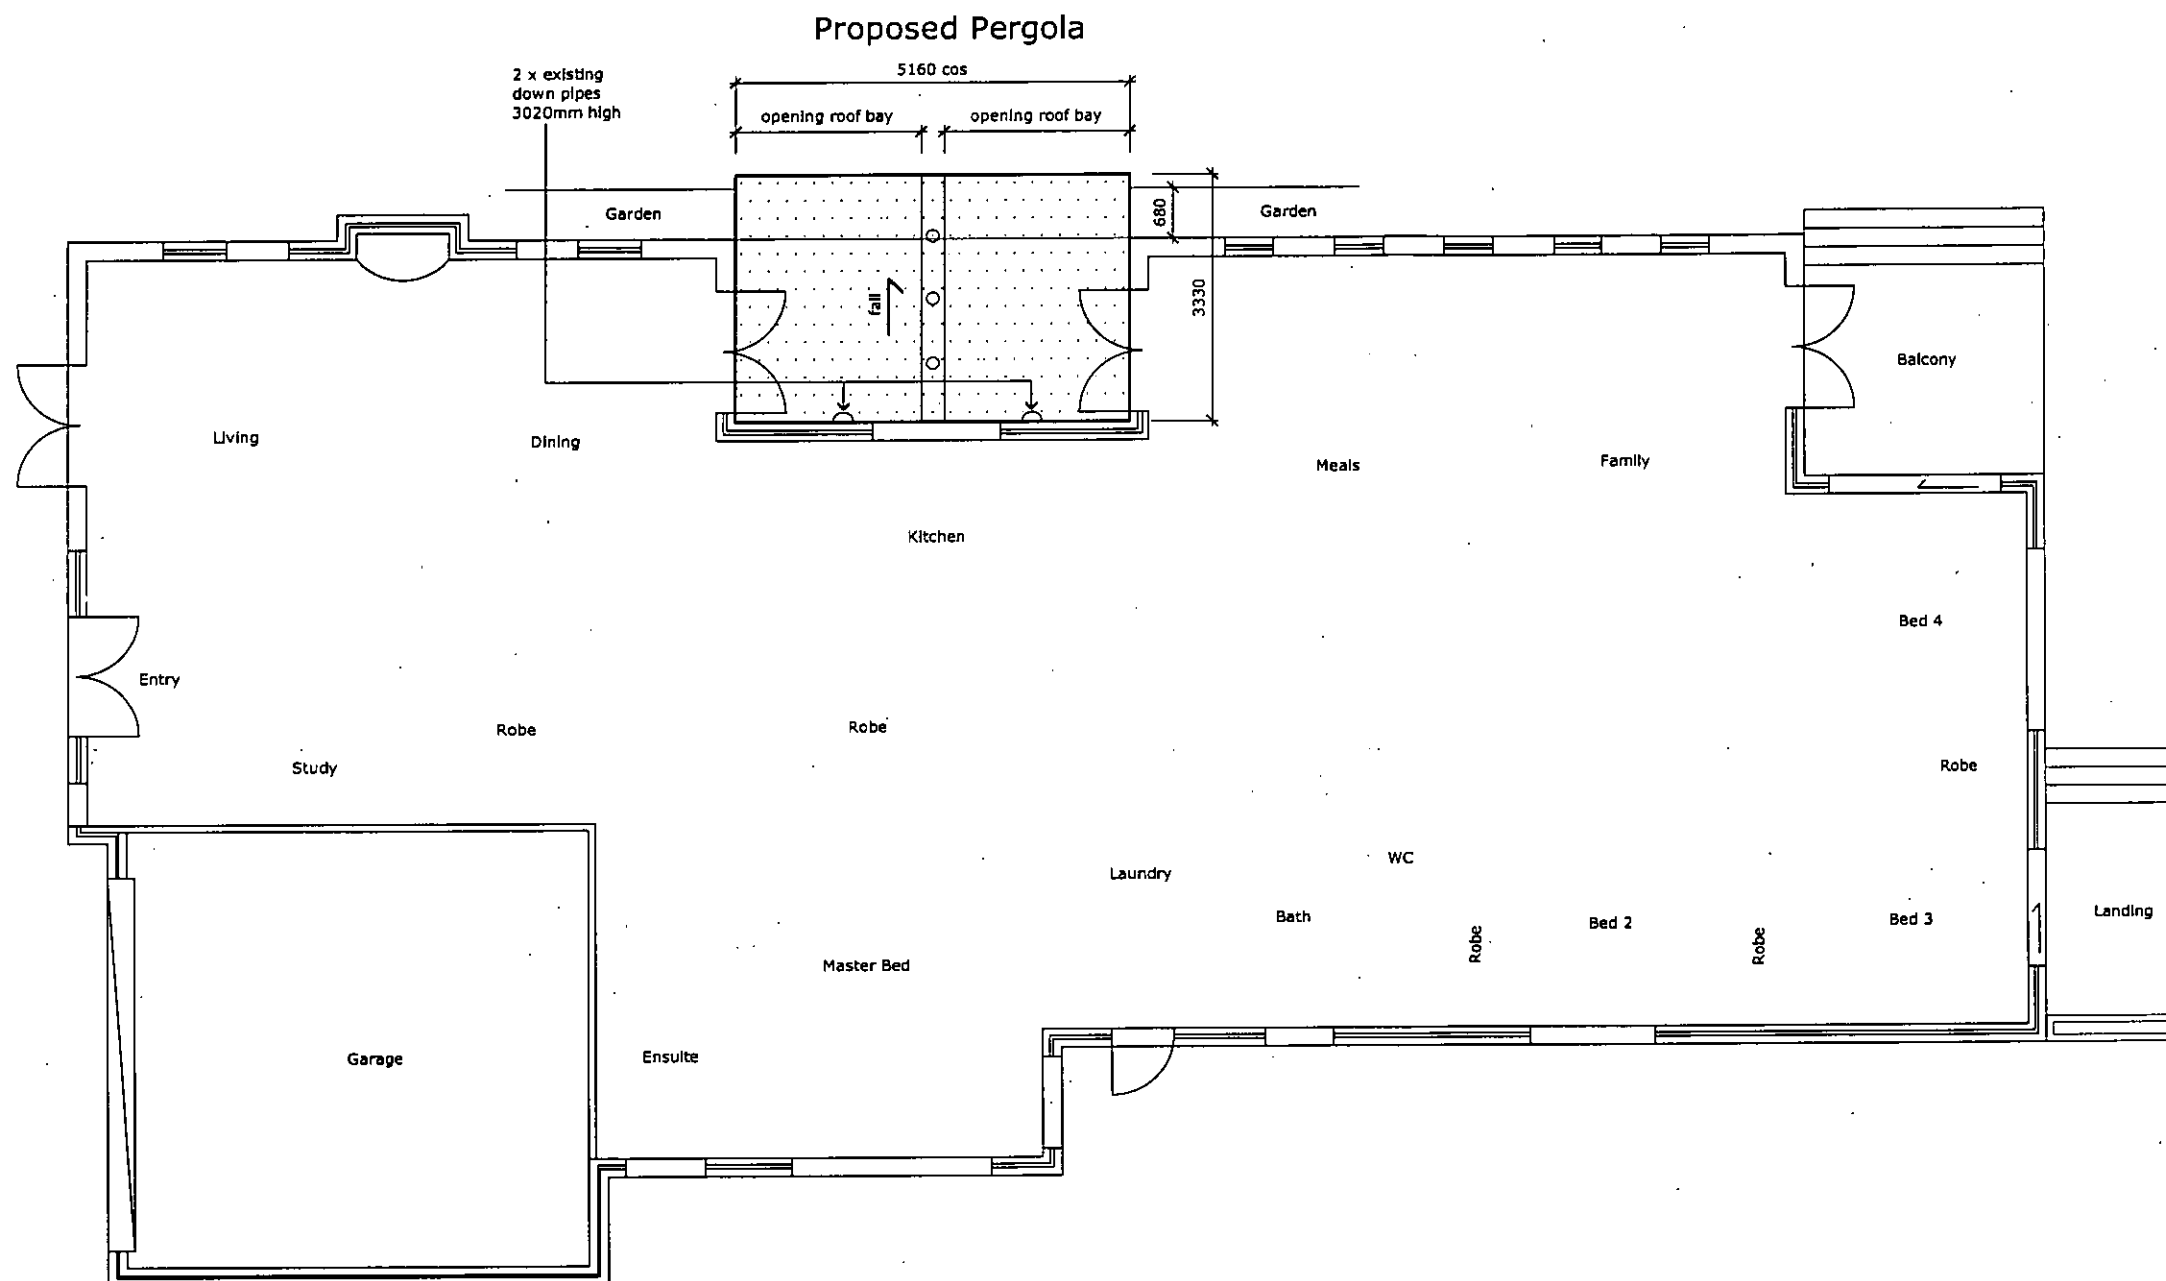

Pergola:

- 1 Proposed 2 bay open / close roof system as shown
- 2 Pergola height to be clear of 2 x existing 3020mm high downpipes
- 3 Pergola to be anchored entirely to 3 x existing residence walls / no posts required.
- 4 Framing to be steel
- 5 3 x downlights to be provided and installed down centre of pergola as shown and as indicated by the following symbol

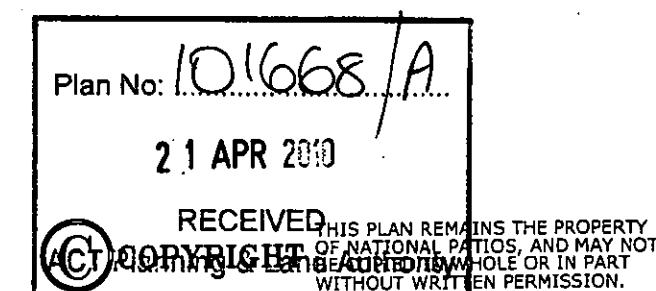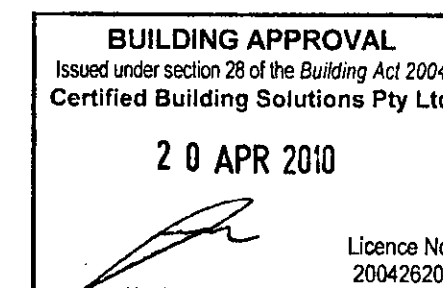

PROJECT: PROPOSED PERGOLA:

BLOCK: 46 SECT: 82 Narrabundah


DISTRICT: CANBERRA CENTRAL

CLIENT: R & R Goldie of:
3 Scott Street Narrabundah

SCALE: 1:100 DWN: N.HILL

DATE: 01 Feb 10 SHEET: 3 OF 4



FLOOR PLAN - for public register

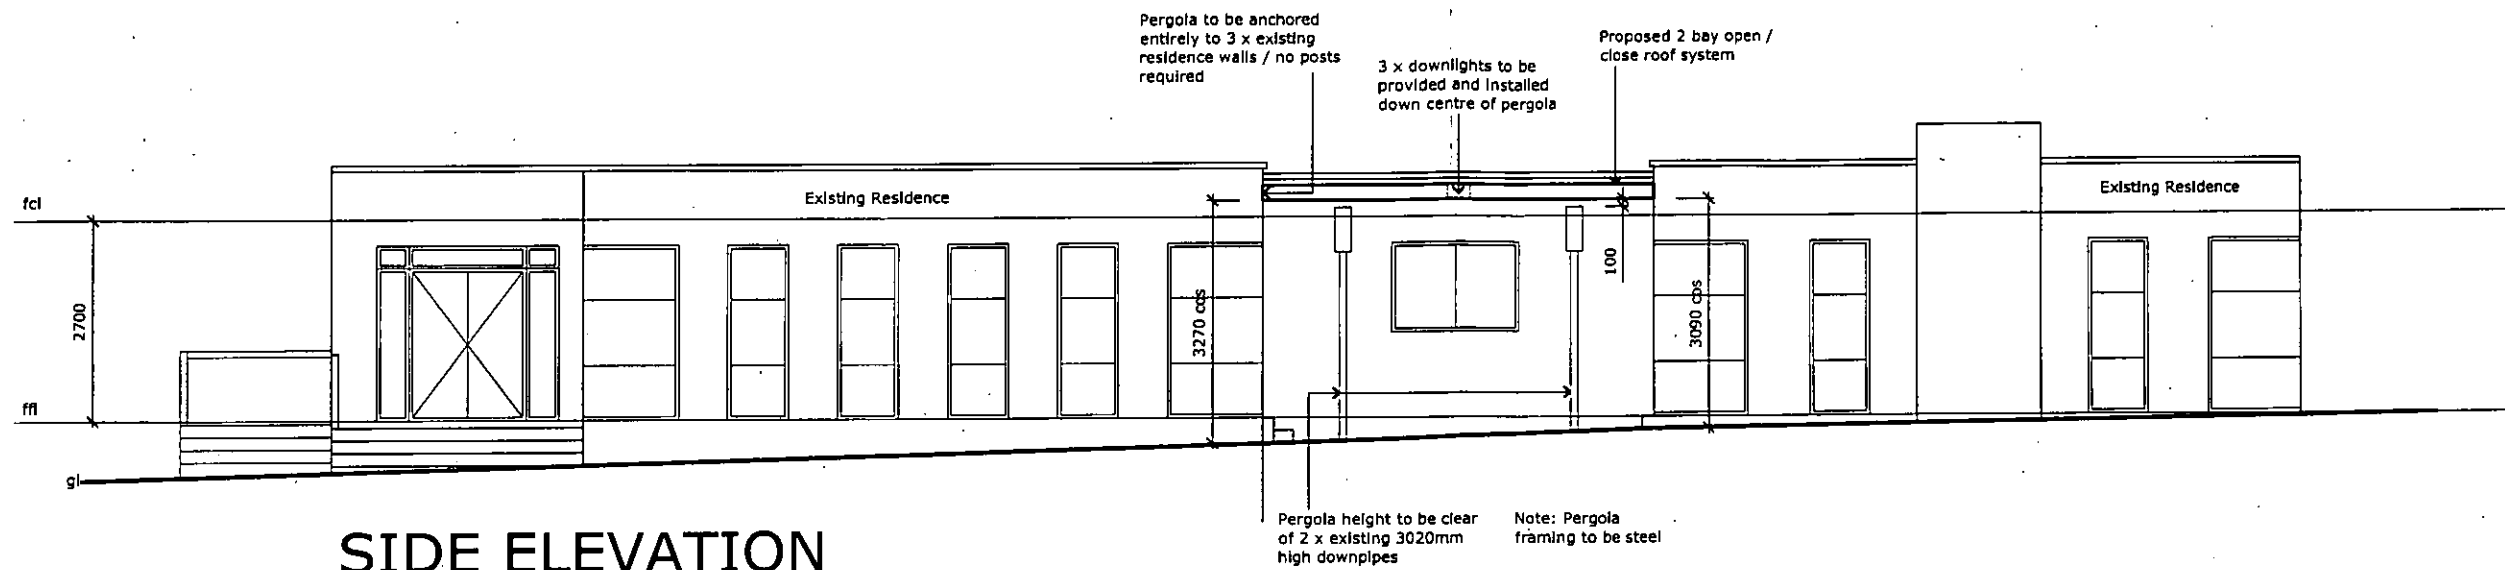

SIDE ELEVATION

Structural elements to comply with all relevant standards, regulations and codes.

All works to be carried out by a licenced builder.
All works to comply with AS, BCA, ACTPLA and all other relevant governmental regulations.

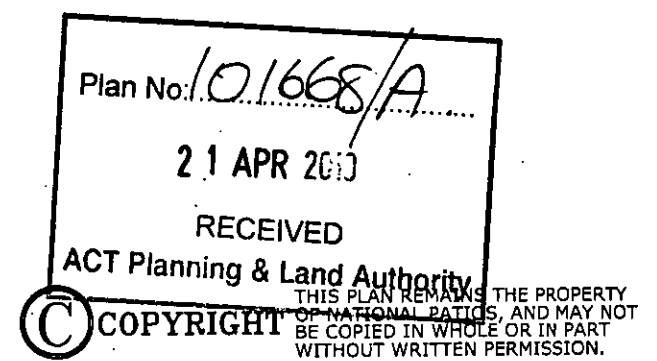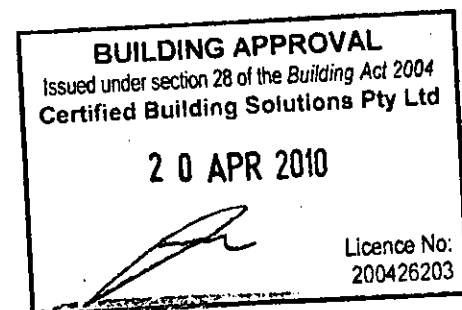

PROJECT: PROPOSED PERGOLA:

BLOCK: 46 SECT: 82 Narrabundah


DISTRICT: CANBERRA CENTRAL

CLIENT: R & R Goldie of:
3 Scott Street Narrabundah

SCALE: 1:100 DWN: N.HILL

DATE: 01 Feb 10 SHEET: 4 OF 4

SEWER	
Tie:	1.2m
Depth:	1.8m
Chainage:	
STORMWATER	
Tie:	1.8m
Depth:	0.99m
Chainage:	

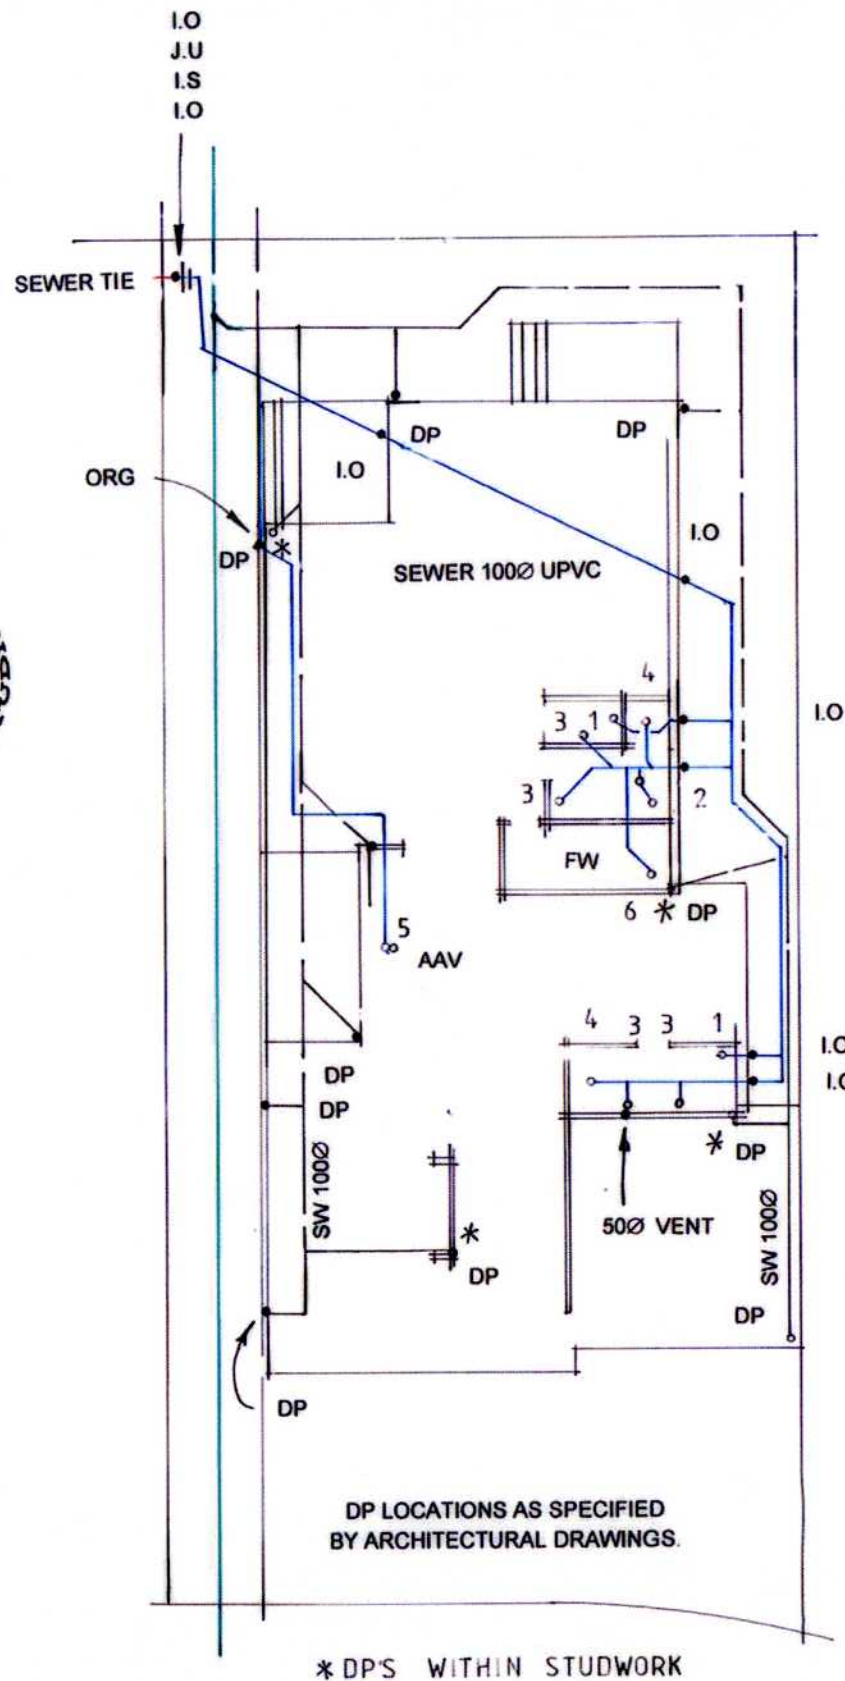

PLAN OF HYDRAULIC SERVICES

OWNER WILSON

DRAINAGE PLAN No 3784

BLOCK 46 SECTION 82 NARRABUNDAH

© COPYRIGHT


REFERENCES				FIXTURES			
V.C.P	VITRIFIED CLAY PIPE	D.T	DISCONNECTOR TRAP	T.D.	TUNDISH	1. WATER CLOSET (2)	7. URINAL ()
S.V.P	SOIL VENT PIPE	I.O	INSPECTION OPENING	G.T	GULLY TRAP	2. BATH (1)	8. CLN'S SINK ()
U.P.V.C	UNPLASTICISED POLYVINYL CHLORIDE	E.J	EXPANSION JOINT	V.P	VENT PIPE	3. BASIN (4)	9. BIDET ()
D.I.C.L	DUCTILE IRON CEMENT LINED	W.S	WATER SERVICE	F.W	FLOOR WASTE	4. SHOWER (2)	11. DISHWASHER ()
O.R.G	OVERFLOW RELIEF GULLY	I.S	INSPECTION SHAFT	J.U	JUMP UP	5. SINK (1)	13. GLASS WASHER ()
F.G.L	FINISHED GROUND LEVEL	H.C	HOSECOCK	E.V	EDUCT VENT	6. LAUNDRY TUB ()	15. COOKING OVEN ()
		F.F.L	FINISHED FLOOR LEVEL	S.T	SILT TRAP		
		S.V	STOPVALVE	B.T	BUCKET TRAP		

ALL WORK TO BE IN ACCORDANCE WITH THE CANBERRA SEWERAGE AND WATER SUPPLY REGULATIONS. THIS PLAN TO BE READ IN CONJUNCTION WITH APPROVED ARCHITECTURAL PLANS. THIS PLAN HAS BEEN DESIGNED IN ACCORDANCE WITH A.S 3500, NATIONAL PLUMBING AND DRAINAGE CODE. ORG TO BE A HEIGHT OF 150mm BELOW LOWEST FIXTURE TO BE DRAINED & A MINIMUM 75mm ABOVE F.G.L.(50mm IN PAVED AREAS, GRADED FROM O.R.G.)



1:200 SCALE REFERS TO DRAINAGE PLAN

1:200 WAE 2/3/09

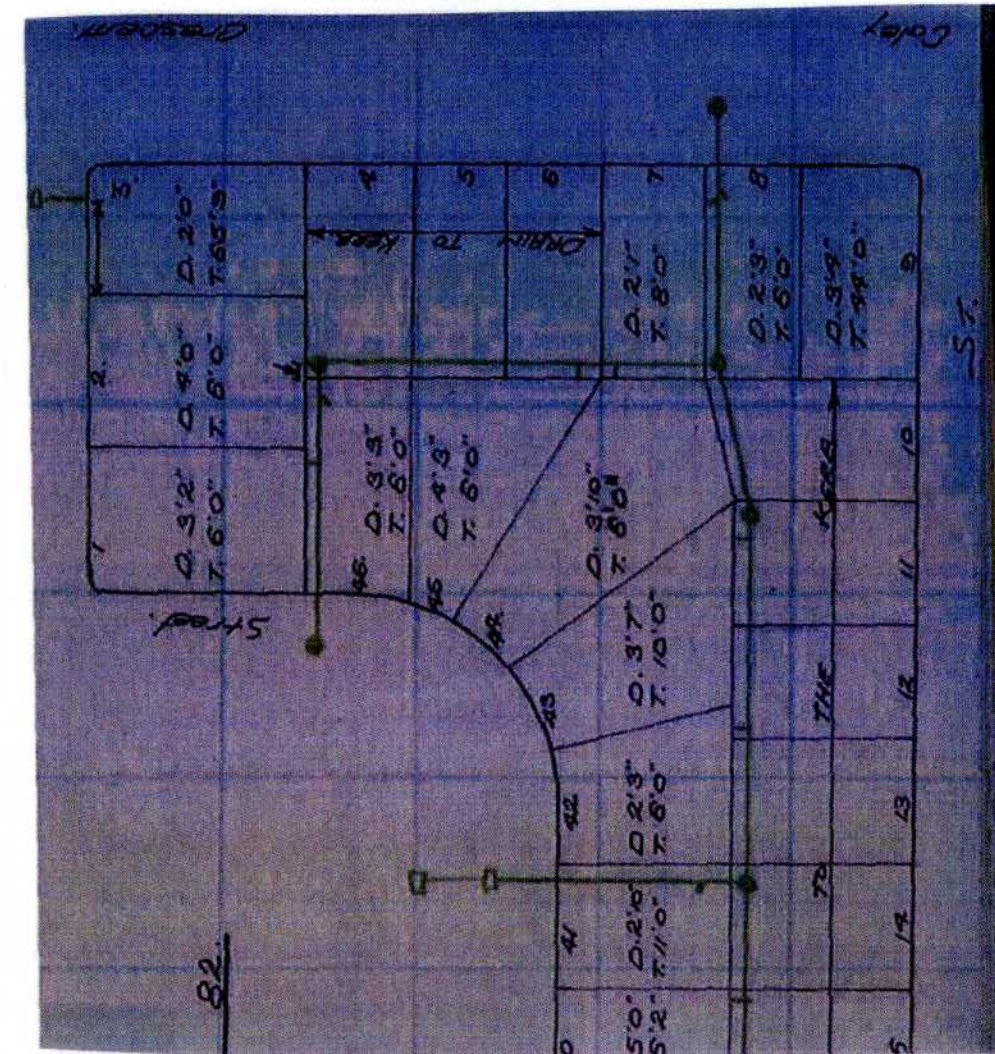

LOCATION PLAN

NOT TO SCALE

SEWERAGE ENGINEER *A Burr* 20/3/09
ENGINEER FOR THE WATER AND SEWERAGE ACT 2001

SW NOTE: PROVIDE 100 DIAMETER PIPE TO THE FIRST JUNCTION AND UNDER BUILDINGS UNLESS NOTED OTHERWISE. GREASE LINES SHOWN IN ORANGE LINES. PROPOSED WASTE PLUMBING SHOWN IN YELLOW LINES. PROPOSED SOIL AND DRAINS TO BE LAID SHOWN IN BLUE LINES. DRAINS DELETED SHOWN BY RED "X". EXISTING DRAINS SHOWN IN GREEN LINES. PROVIDE INSPECTION OPENINGS ON EACH WC BRANCH OF INTERVALS OF NOT MORE THAN 30m SPACED EQUIDISTANT IMMEDIATELY UP & DOWNSTREAM OF ALL JUMP UPS. VITRIFIED CLAY PIPES TO BE IN ACCORDANCE WITH AS1693 & AS A164. UPVC PIPES TO BE IN ACCORDANCE WITH AS1280. PROVIDE FIRE STOP COLLARS TO ALL UPVC PENETRATIONS OF FIRE RATED FLOORS AND WALLS. THIS BASE DRAINAGE PLAN REMAINS THE PROPERTY OF THE ARCHITECTURAL DESIGN STUDIO & IS NOT TO BE COPIED WITHOUT THE EXPRESS WRITTEN PERMISSION OF ANTHONY BURR. WHILST EVERY PRECAUTION IS TAKEN TO ENSURE THE ACCURACY OF THE NOTES &/OR DRAWINGS NO RESPONSIBILITY &/OR LIABILITY WILL BE ACCEPTED FOR ANY ERRORS &/OR OMISSIONS IN THE TEXT &/OR DRAWINGS. IT IS THE CONTRACTORS RESPONSIBILITY TO ESTABLISH THE LOCATION OF ALL EXISTING SERVICES & THE SUITABILITY OF THE DESIGN PRIOR TO COMMENCING CONSTRUCTION. CHECK POSITION OF TIE PRIOR TO COMMENCING CONSTRUCTION. INSPECTION SHAFT TO BE LOCATED AT THE PROPERTY BOUNDARY IS TO BE RAISED TO GROUND LEVEL IN ACCORDANCE WITH PLUMBING NOTE 3.

DESIGN STUDIO

3 Buru Close Ngunnawal Canberra 2913 ACT Anthony 0414 244 518
e-mail daf@webone.com.au Phone 6241 7138 Facsimile 6241 8681

Project: 2008/14386 Scale: 1:200 Design by Anthony Burr

SCOTT ST

PAYMENT PENDING

As per terms and conditions in the
Residential Reports Client Guarantee



Tax Invoice

Inspection Number 47407

Please ensure this number is used when making payment

29 June 2026

Francesca Sfyrakis

For the Property at: 3 Scott Street Narrabundah ACT 2604

NO PAY UPFRONT RAPID INSPECTIONS PACKAGE	
Access Canberra conveyancing fees (no GST)	181.00
Property Inspection and Report (package price)	520.00
Timber Pest Inspection and Report (package price)	490.00
Building Compliance Inspection and Report (package price)	475.45
First Rate Energy Efficiency Inspection & Report (complimentary)	0.00
Subtotal	1,666.45
Total GST	148.55
TOTAL INC GST	\$1,815.00

Thank you for your business

We offer comprehensive Pest Management Solutions!

Call now to book your regular Pest Control Service

No Pay Package Conditions: This invoice must be paid on settlement or within 180 days of the date of inspection, whichever comes first. We must be notified immediately if the property is not marketed within 3 months or is withdrawn from the market and the invoice must be settled within 14 days. Failure to adhere to these terms will result in associated legal and collection fees being applied to amount due.

PAYMENT OPTIONS	
	To avoid unallocated payments please use reference number: 47407
Credit Card	Please call 6288 0402 to provide card details. Your account is not debited until the day reports are released. Providing these details as soon as possible will ensure there is no delay when reports are ready.
Direct Deposit	Account Name: Residential Reports BSB: 012-997 Account Number: 2269 05945 Reference: 47407 IMPORTANT: PLEASE ensure this unique ID is used



A PERCENTAGE OF EVERY JOB IS DONATED TO OUR WITHOUT A ROOF PROGRAM

Every year we step into hundreds of homes, yet in our region there are still so many people living without acceptable, permanent or safe shelter. A percentage from each inspection we conduct is contributed to our in-house program 'Without a Roof' and periodically donated to make small changes to this big issue. To find out more visit residentialreports.com.au

Residential Reports Pty Limited ABN 38 609 880 122

35 Poynton Street Hughes ACT 2605 p 6288 0402 info@residentialreports.com.au

Member- Master Builders Association & The Australian Environmental Pest Managers Association